







Floor Convectors













CONTENT:

Introduction	
Economy, energy saving and safety	
TERMO DYNAMIC lypes	
Construction, running and warranty conditions	
Section 2 and training section 2 and 1 and 2 and	
GRILLS	
Grills	
CROSS-FLOW FAN CONVECTION 24V	
Convector with fans 24V DC	
Designing of 24V DC	
FLT 24 V DC floor covector regulation	
Accessories for 24V DC convectors	
FLT10-09	
FLT20-09	
FLT10-11	
FLT20-11	
HEATING, COOLING CONVECTORS 24V DC	
heating, cooling convectors 24V DC	
Designing of FCC 12V	
Regulation of FCC 24 V DC	
Accessories for FCC 24 V DC	
FCC2A-13 24V	
FCC4A-13 24V	
CONVECTORS FOR SWIMMING POOLS 12V DC	
Convectors for swimming pools 12V DC	
Designing of FLB 12V DC	
Regulation of 12V DC	
Accessories for 12V DC convectors	
FLB20-12	
NATURAL CONVECTION	
Convectors with natural convection	
Designing	
FLK convector regulation	
Accessories for FLK convectors 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2 2	
FLK10-09, FLK20-09, FLK30-09, FLK40-09	
ANTHORN THE THEORY OF THE PROPERTY OF THE PROP	

Atypical convector
Ordering form



24V DC

Termo Activ is a new series of floor convectors, focused on electric power saving, intelligent control and operating safety. The economy is defined by inquiries of highly developed countries inclusively the EU markets.

Convectors equipped with FLT, FCC fans work with safe direct-current voltage of 24V DC. Built-in fans characterized of low electric power consumption (in watt order) are provided with regulation units evaluating the values and reacting to the room environs. Revs correction, frost protection, window sensors and other algorithms take care for protection of user's regulation system against undesirable heat leakage or local piping freeze; the heating output has been adapted to ambient conditions. The automated mode enables comfortable operation all the year round.

Floor convector control:

- room thermostat
- in convector installed regulator

THERMOSTAT is a "brain" of the whole system controlling its performance, enabling continuous revs adjustment, moderate heating, automated and antifreeze modes. It is able to differentiate between requirements for heating and cooling either. It can be used for working in double-tube as well as in four-tube heating systems.

REGULATOR is an independent element ensuring the right fan running and by means of sensors regulating the output values for the convector to work independently and to prevent heat leakage or exchanger damage.

CIB protocol. The convector may be integrated in **Building Management Systems** (BMS - Tecomat Foxtrot, Lon Works, EIB and the like).

24V DC FANS with electric commutation (EC-Technology), smooth revs regulation and efficiency of over 90 % have almost double lifetime in comparison with usual AC-engines. The continuous revs regulation of 24V DC engines used with FLT, FCC convectors follows by 0-10V input (eventually by PWM-signal).

HEAT EXCHANGERS SPIRO Cu-Cu

Cooper wire heat exchangers, special technology of wire basket on supporting cooper pipe


- mechanical resistance high rigidity prevents damage during installation and cleaning
- · easy cleaning wire construction prevent from dust settling
- stable chracteristics soldered construction ensures long-term stable performance of the exchanger SPIRO
- flexibility easy flexibility while maintaining the aesthetic appearance and functional properties






FLT FLOOR CONVECTOR WITH FAN


24V DC - FLOOR CONVECTORS, DIRECT-CURRENT VOLTAGE





115 00

320 0 o



FET10-09

270×90×800-4800 mm Q 75/65/20 °C 262-3188 W Q 55/45/20 °C 148-1808 W heating, 2 pipe system page 12

FLT20-09

320×90×800-4800 mm Q 75/65/20 °C: 545-6643 W Q 55/45/20 °C: 301-3670 W heating, 2 pipe system page 13

FLT10-11

270×115×800-4800 mm Q 75/65/20 °C: 233-2566 W Q 55/45/20 °C: 134-1472 W heating, 2 pipe system page 14

FLT20-11

320×115×800-4800 mm Q 75/65/20 °C: 461-5074 W Q 55/45/20 °C: 270-2970 W heating, 2 pipe system page 15


FCC2A, FCC 4A

320×134×1200-2800 mm Q75/65/20 °C: 2001 -6003 W Q55/45/20 °C: 1191 - 3574 W heating, cooling, 2 and 4 pipe system page20, 22

12V DC - FLOOR CONVECTORS FOR SWIMMING POOLS

FLB20-12


270×125×800-4800 mm Q 75/65/20 °C: 422-4647 W Q 55/45/20 °C: 213-2348 W heating, cooling, 2 pipe system page 28





Note: Heat outputs correspond to the middle speed of a fan

FLOOR CONVECTOR WITH NATURAL CONVECTION












FLK10-09

170×90×800-4800 mm Q75/65/20 °C: 95-945 W Q55/45/20 °C: 45-446 W heating, 2 pipe system page 34



FLK30-09 320×90×800-4800 mm Q75/65/20 °C: 161 - 1655 W Q55/45/20 °C: 76-789 W


360×90×800-4800 mm Q75/65/20 °C: 227-2193 W Q55/45/20 °C: 118-1118 W heating, 2 pipe system page 34


FLK40-09

420×90×800-4800 mm Q75/65/20 °C: 293~2731 W Q55/45/20 °C: 160~1447 W heating, 2 pipe system page 34


FLK10-11

170×115×800-4800 mm Q75/65/20 °C: 102-1011 W Q55/45/20 °C: 48-487 W heating, 2 pipe system page 36






heating, 2 pipe system page 34







FLK20-11

320×115×800-4800 mm Q75/65/20 °C: 174-1798 W Q55/45/20 °C: 84-859 W heating, 2 pipe system page 36

FLK30-11

360×115×800-4800 mm Q75/65/20 °C: 246-2341 W Q55/45/20 °C: 118-1118 W heating, 2 pipe system page 36

FLK40-11


420×115×800-4800 mm Q75/65/20 °C 318-2884 W Q55/45/20 °C 152-1377 W heating, 2 pipe system page 36


FLK10-14

170×140×800-4800 mm Q75/65/20 °C: 117-1162 W Q55/45/20 °C: 55-549 W heating, 2 pipe system page 38

FLK20-14


320×140×800-4800 mm Q75/65/20 °C 215-2229 W Q55/45/20 °C 104-1065 W heating, 2 pipe system page 38






300 0 (0

180





FLK30-14

360×140×800-4800 mm Q75/65/20 °C: 317-3019 W Q55/45/20 °C: 152-1442 W heating, 2 pipe system page 38

FLK40-14

420×140×800-4800 mm Q75/65/20 °C: 394-3576 W Q55/45/20 °C: 188-1707 W heating, 2 pipe system page 38

FLK20-18

300×180×800-4800 mm Q75/65/20 °C: 257-2787 W Q55/45/20 °C: 124-1346 W heating, 2 pipe system page 40

360×180×800-4800 mm


Q75/65/20 °C 293-3180 W Q55/45/20 °C 142-1536 W heating, 2 pipe system page 40

FLK20-30

300×300×800-4800 mm Q75/65/20 °C: 289-3131 W Q55/45/20 °C: 135-1460 W heating, 2 pipe system page 40

FLK30-30

360×300×800-4800 mm Q75/65/20 °C: 419-4284 W Q55/45/20 °C: 195-2118 W heating, 2 pipe system page 40



CONSTRUCTION



STAINLESS TANK

is made of stainless steel DIN 1,4301 (17240), wall thickness 0.8 mm, inner surface treatment by spray painting is also available. The tank containing all the convector functional elements is provided with openings for water inlet/outlet and for electric cables connection (FLT types). A solid peripheral aluminium frame holds a upper grill. The construction stiffened with inner ribs contains levelling screws for height adjusting within the installation.

HEAT EXCHANGER Cu-Cu, Al-Cu

Heat exchangers Cu-Cu have special wire basket soldered on a copper tube through which the heat carrier circulates. The air flowing among wires distributes the collected heat to the room. The exchanger is provided with an air release valve and connection female thread G1/2". Al-Cu exchangers have aluminium lamellas firmly pressed on a copper tube. It is used at FCC types where the construction is useful for four pipe system.

UPPER GRILL

is a final visual element of the installed floor convector. The client may have a grid flooring, the long ribs of which follow the window line (material: aluminium, wood, stainless steel) or the client may choose a grill with short perpendicular ribs (material: aluminium). Convectors installed in floating floors can be decked with finishing cover ledges.


TANGENTIAL FANS

Tangential fans obtain forced air circulation reflected in more effective use of exchanger heating capacity in comparison with natural air circulation (FLT, FCC types). Shields covering the rotating parts of engine prevent accidents, injuries and fan damages. The integrated regulator enables comfortable regulation of the floor convector heating capacity.

REGULATION

A regulator placed in the convector controls the fan revs and flow rate of the heating medium through exchanger. The regulator follows instructions by wall thermostat installed in the room. Regulation, fans and convector speed control working under safe voltage 24V DC.



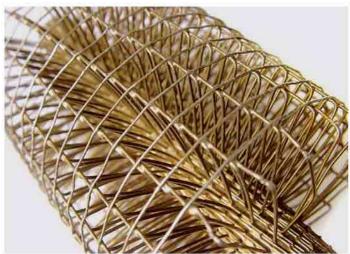

RUNNING CONDITIONS



- Warm-water heating system with forced circulation
- Heat medium operating temperature, max. 110 °C
- · Heat medium operating overpressure, max. 1 MPa
- · Electric parts IP 20, operating voltage 24V DC, dry environs
- The convector is construed for ambient temperature between +2 and 40 °C and relative moisture of 20-70 %

WARRANTY CONDITIONS - EXTRACT



The Seller's warranty covers joint tightness, surface treatment, proclaimed values of heating capacity and loss in pressure relating to heating bodies professionally installed in a closed and sealed system in accordance with applicable standards and decrees, this all under the aspect that the used medium must only serve as the heat carrier. Other usage is excluded.

Electric heating bodies shall be professionally installed in accordance with the applicable standards. FLT, FCC floor convectors with fans, IP 20 – dry environs.

PERIODS OF RISK

The period of risk is 5 years for joint tightness, 10 years for exchanger and 2 years for electro-installation and stainless steel tank.



Convector becomes a functional design element of the interior by correct choose of upper grill suitable material and colour. The grill is fit in a massive aluminium peripheral frame creating an optical boundary between the floor and convector.

ALUMINIUM GRILLS

ROLL-UP GRILLS

The spacing between spring loaded transverse lamellas of aluminium alloy is delimitated by residual rollers made of cured plastic. The lamellas have anodized and tinted surface. Any RAL shade may be reached by powder colour coating.









Grill supply is included in price, RAL shades to order.

LINEAR GRILLS

Lengthwise perforated aluminium lamellas are linked by carrying steel bar. Residual rollers of cured plastic delimitate the spacing.









WOODEN GRILLS

ROLL-UP GRILLS

The spacing between spring loaded oak or beech lamellas is delimitated by residual rollers made of cured plastic. The surface is raw or stained.









Roll-up grill, stained oak Al-frame, bronze

STAINLESS STEEL GRILL

TRANSVERSE GRILL

Stainless steel rectangular profiles are linked by steel drawbars. The spacing of lamellas is delimitated by residual metal rollers. A fix non-rolling grill.





A grill available to order, calculation as per the convector type.




FINISHING COVER LEDGE


 for installation in wooden and floating floors to cover the dilatation joints

 variants available: Al natural, Al bronze (anodized aluminium) or coated with powder colour acc. to RAL


- · covers dilatation joints up to 10mm
- profile 20x20x1.5 mm
- · ledge is a part of convector package
- installation after the finished convector mounting
- marking D instead of R in the code, colour matching with surface treatment of the frame (D1-1, D2-1,D3-1, D2-1, D2-2, D3-2, D6-1, D6-2, D6-3, D6-4, D5-1)

Because of modified grill width of convector, the option is to be specified when ordering the heating body. The top edge of convector frame may not protrude from the final floor level.

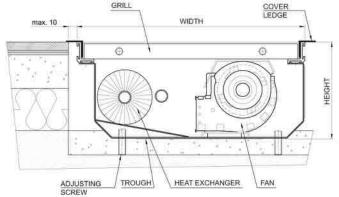




Grill cross section



Frame detail



Non standard frame





Samples of floor convector coding:

FLT20-11120-NR115 - convector with Al-frame and grill

FLT20-11120-ND115 - convector with Al-frame, modified grill and cover ledge

Ordering, see the page 44



Floor convector equipped with tangential fans is characterized of high heating capacity surpassing the same of convector with natural convection. By using of quiet tangential fans and in connection with intelligent regulation, the convector became a full-bodied heating element for utilization in modern buildings.

Convector is fitted with Cu-Cu wire heat exchanger through which heating medium is flowing. Lengthwise placed tangential fans guarantee a balanced exchanger covering and subsequently an optimized heat distribution to the room.

- · High heating output
- · Energy saving fans
- 24V DC
- · Continuous revs regulation

TYPES WITH 24V DC TECHNOLOGY:

FLT10-09 (270×90×800-4800 mm) FLT20-09 (320×90×800-4800 mm) FLT10-11 (270×115×800-4800 mm) FLT20-11 (320×115×800-4800 mm)

24V DC FANS

The installed modern fans with **EC** engines work under the operating voltage of **24 V DC**. The continuous engine revs regulation **0–10V** enables accurate control of floor convector output. Power consumption of a fan is specified in watt units. Only one thermostat and one regulator is sufficient for all convectors installed in a standard room.

TABLE OF CONVECTOR ELECTRIC POWER INPUTS

- Convectors are equipped with continuously speed regulated 24V DC fans
- Recommended FLT floor convectors regulation is in the range of 0-4V
- The table below shows power take-off relating to fans performance within the standard speed gears of 1, 2, 3
- The highest possible power input of fans (control voltage of 10V) is specified for complete utilization of the available regulation levels

Table of fans electric power input (FLT types)

		Revolutions					FLT con	vector leng	th [mm]				
TYPE	Speed	[rpm]	800	1200	1600	2000	2400	2800	3200	3600	4000	4400	4800
	1	576	2W	2W	2W	4W	4W	5W	5W	6W	7W	7W	9W
FLT10-09	2	762	2W	2W	3W	4W	5W	6W	7W	7W	9W	9W	11W
FLT20-09	3	1057	3W	4W	4W	7W	8W	10W	11W	ITW	14W	15W	17W
	max.*	2394	18W	18W	18W	36W	36W	54W	54W	54W	72W	72W	90W
	T	465	2W	2W	3W	3W	5W	5W	6W	6W	8W	8W	9W
FLT10-11	2	582	2W	2W	4W	4W	6W	6W	8W	8W	10W	10W	12W
FLT20-11	3	756	4W	4W	7W	7W	10W	10W	13W	13W	16W	16W	19W
	max.*	1519	20W	20W	40W	40W	60W	60W	80W	80W	100W	100W	120W


^{*} revs max, are not regulated for the case of installation SR201,

Note: add accessories to the convector output - thermo-electric drive 6.5 VA - at switching-on (operation power input 2.5 W)

- SR201 2.5 W speed controller


RECOMMENDED STANDARD INSTALLING IN FLOOR

- · Convector installation with exchanger towards window
- · ideal position 100-200 mm distance from window
- · fan draws in the room air
- · the air is warmed up by flowing through exchanger
- · hot air is mixed with cold air flowing off the window surface
- air circulation: warms up the room air
 - screens the window surface
 - secondary demisters the window surface

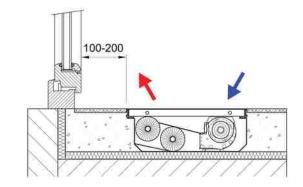

CONVECTOR CONNECTION TO THE HEATING SYSTEM

Floor convector is fitted with openings for connection to the heating system. There are three connection possibilities, from the room, side or window wall.

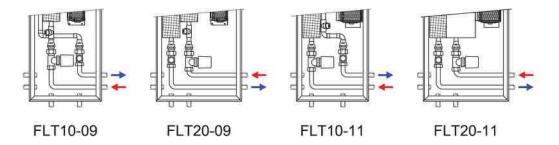



HEATING OUTPUT RECALCULATION FOR ANOTHER TEMPERATURE GRADIENT

Convector heating output reckoning follows by recalculation of the standardized output Qn $75/65/20~^{\circ}\text{C}$

$$Q = Qn * \Psi * \left(\frac{\Delta T}{50}\right)^m \text{ [W]; where } \Delta T = \left(\frac{T1 + T2}{2}\right) - Ti \text{ [°C]}$$

m=1,1103 for FLT10-09 m=1,1613 for FLT20-09 m=1,0872 for FLT10-11 m=1,0483 for FLT20-11

Qn [W] heating output for temperature gradient T1/T2/Ti = 75/65/20 °C

 ψ [-] mass rate of flow coefficient (for current flow rate ψ =1)

T1 [°C] input water temperature
T2 [°C] output water temperature
Ti [°C] temperature in the room
m [-] temperature exponent

QUICK CONVERSION TO TI=22 °C A TI=15 °C FOR ORIENTATION

- If you want to learn convector output for the room temperature of 22 °C or for a corridor temperature of 15 °C
- multiply heating output of the chosen convector by the " \mathbf{k} " coefficient

For Ti=22°C, k=0.95

E.g.: Q [55/45/22 °C] = 0.95 * Q [55/45/20 °C]

for Ti=15°C, k=1.12

E.g.: Q [75/65/15 °C] = 1.12 * Qn [75/65/20 °C]

HEATING WATER FLOW RATE THROUGH EXCHANGER

M = 0.86Q/(T1-T2) [kg/h]

M [kg/h] mass rate of flow, heating water flowing through exchanger

Q [W] convector heating output

T1-T2 [°C] difference between input and output temperature

0.86 [-] invariable for recalculation of units

CONVECTOR DIMENSIONING BASED ON ACOUSTIC PARAMETERS

- Convector heating output must cover thermal loss in the room and observe the acoustic parameters
- · Permissible noisiness levels are determined by national legislation
- Different values of permissible noisiness levels are valid for residential houses, hospitals, offices, hotels etc.
- Heating output of convector with fan is designed for revolutions conforming with the lowest admissible acoustic pressure level in the room
- Tables of acoustic pressure L_{pAmax} [dB(A)] are in chapters relating to the single floor convector types
- Quoted measuring of acoustic parameters follows diagonally in the distance of 1m above and 1m in front of the convector
- The acoustic field may differ in dependence on:
 - convector placing in the room and its appropriate installation
 - the room space and segmentation (corners, partitions, ceiling)
 - furnishings as absorbing elements: tables, chairs, cupboards, wardrobes, carpets etc.
 - installation of more convectors in one room
 - sometimes, e.g. when convector is placed in a corner, the noisiness parameters may show values increased by 3dB(A)

EXCHANGER HYDRAULIC LOSSES

COLUMN TO THE REAL PROPERTY.	Length	Volume			M	– mass ra	te of flow i	n piping (l	kg/h)/R-	hydraulic	loss in exc	hanger (k	Pa)		
TYPE	[mm]	[II]	M=20	40	60	80	100	120	150	200	250	300	350	400	450
	800	0,11	0,01	0,03	0,06	0,11	0,17	0,25	0,39	0,69	1,07	1,55	2,11	2,75	3,48
	1200	0,21	0,01	0,03	0,08	0,14	0,21	0,30	0,48	0,85	1,32	1,91	2,59	3,39	4,29
	1600	0,32	0,01	0,04	0,09	0,15	0,24	0,34	0,53	0,94	1,48	2,13	2,89	3,78	4,78
	2000	0,43	0,01	0,04	0,09	0,16	0,26	0,37	0,58	1,02	1,60	2,30	3,13	4,09	5,18
FLT10-09	2400	0,53	0,01	0,05	0,10	0,19	0,29	0,42	0,65	1,16	1,81	2,61	3,55	4,64	5,87
FLT20-09 FLT10-11	2800	0,64	0,01	0,05	0,11	0,19	0,30	0,43	0,68	1,20	1,88	2,71	3,69	4,82	6,09
FLT20-11	3200	0,74	0,01	0,06	0,13	0,23	0,35	0,51	0,79	1,41	2,21	3,18	4,33	5,65	7,15
	3600	0,85	0,01	0,06	0,13	0,23	0,36	0,53	0,82	1,46	2,28	3,28	4,47	5,84	7,39
	4000	0,96	0,02	0,09	0,20	0,36	0,56	0,81	1,27	2,26	3,52	5,08	6,91	9,02	11,42
	4400	1,06	0,02	0,09	0,21	0,37	0,57	0,82	1,29	2,29	3,58	5,15	7,01	9,16	11,59
	4800	1,17	0,02	0,09	0,21	0,37	0,58	0,84	1,31	2,33	3,64	5,24	7,14	9,32	11,80

PARAMETERS OF LOCKSHIELD VALVES

T-turns	0,5	0,75	1	1,5	2	2,5	3	3,5	4	5	6	MAX
Kv (m³/h) - direct version	0,3	0,4	0,55	0,75	0,91	1,05	1,25	1,33	1,4	1,6	1,7	1,8
(v (m³/b) = corner version	0.2	0.25	0.20	0.4	0.5	0.69	0.8	1	1.2	1.55	10	2.2

parameters of free packed in lockshield valves

FLT 24V DC FLOOR CONVECTOR REGULATION




Regulation of floor convector with installed power saving 24V DC fans enables to utilize a modern control technology. Convector becoming a part of the heating system evaluates the situation and reacts to outer incentives. By means of very simple control and due to antifreeze protection eliminating any heat leakage, the heated room has all precon-

ditions for comfortable dwelling. The regulator power consumption is negligible. Communication between floor convector and thermostat follows by data flow based on CIB protocol. The system may be easily integrated in Foxtrot-BMS. Modifications for LonWorks, EIB, KNX and others are available to order.

REGULATION BY MEANS OF RTM 101 THERMOSTAT AND INSTALLED SR201 REGULATOR

TEMPERATURE SETTING UP



15-30 °C range for heating ∗ ∗ ⋄ ⋄ ⋄ range for cooling

The system automatically changes between heating / cooling in dependence on ambient temperature and according to the temperature of heating medium flowing through exchanger. The medium flowing and the fans are stopped, as soon as the desired temperature in the room is reached.

Modes:

OFF convector off

AUTO automated regulation of floor convector detecting the actual room temperature; the mode regulates continuous revs adjustment of fans, watches over the exchanger temperature, switches between heating and cooling, reacts to window sensors

TEMP moderate heating, the fans are off, only the flow rate of heating medium is active

1-5 continuous fan revs regulation according to the user's demand

Sleep mode (


Decreases the demand for thermostat setting by -2 °C (heating) or +2 °C (cooling). It is not necessary to reset the thermostat parameters for the night or for a period of absence in the house. The sleep mode is signalized by LED diode on the thermostat cover.

Antifreeze protection

Regulator switches on a thermodrive when the local temperature drops below $5\,^{\circ}\text{C}$ around the floor convector. So, the heating medium flowing through exchanger prevents any system damage. The antifreeze protection functions within all mode options, inclusively the OFF-mode. The antifreeze protection is only available, when the heating system is supplied with heating medium.

Window sensors

In case of installed window sensor, regulator stops the convector running during ventilation. The antifreeze protection remains active and after the window is closed, system returns to the standard mode.

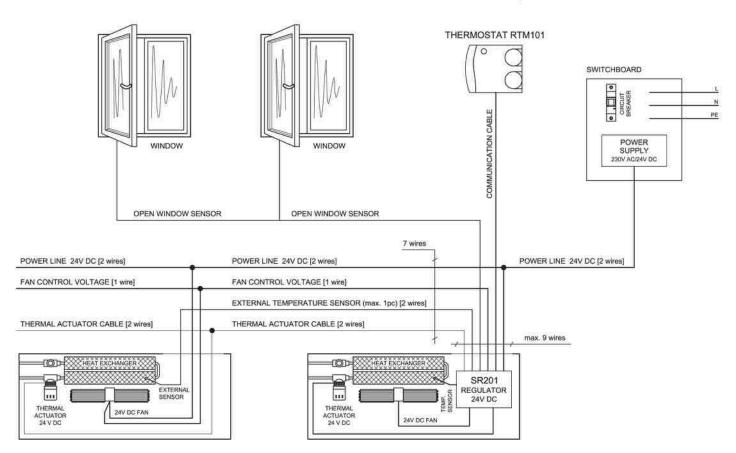

For current installation, you only need 1 thermostat, 1 regulator and 1 power supply unit per a room.

In case of extended projects, where the power input of installed convectors goes beyond 100W, an additional regulator and a stronger power supply unit is to be installed. Please contact the manufacturer.

ACCESSORIES FOR 24V DC CONVECTORS



RTM101

Room thermostat, heating/cooling, continuous revs regulation, sleep mode, OFF, AUTO and TEMP modes,

continuous revs range 1-5

 Colour:
 white

 Communication:
 CIB protocol

 CIB parameters:
 24V DC; 2.2W

 Dimension:
 98×106×34 mm

Ingress protection: IP30



CIB fan controller for double pipe, regulation modulus heating/cooling, double-tube heating system containing exchanger temperature sensor for ISAN FLT convectors

Operating voltage: 24V DC
Communication: CIB protocol


Inputs: 24V DC, control signal from bus-bar and sensors
Outputs: control signals for fans, 24V DC for thermo-drives



24V DC power supply unit, placing on DIN ledge Input voltage: 240V /50Hz
Output voltage: 24V DC

Final nominal output / current DR60-24 **60W**/2.5A

DR100-24 100W/4.2A



Input voltage: 24V DC
Power input when switch on: 6VA
Power input during operating: 2.5W
Period of switching ON/OFF: 270 s
Ingress protection: IP54 (hc

en opened: 74 mm

Max. height when opened: 74 mm

73 (Affice) 89 (MA) 43 65



External temperature sensor as "antifreeze protection"

Sensor type: thermistor

Temperature range: from -30 °C to 90 °C

Cable length: 5 m
Connection: by 2 cables

Z-TD001 direct, Z-TE001 corner

Thermostatic valve installed on the exchanger input tube regulates the flow rate of heating medium through the heat exchanger

Dimension: DN15, NF norm
Connection thread: M30×1.5mm
Operating temperature, max. PN10
Operating pressure, max.

Valve adjusting	7.	2	3	4	5	N
k _v (m ³ /h)	0,1	0,2	0,31	0,45	0,69	0,89



Z-RD002 direct, Z-RE002 corner

Lockshield valves

Dimension: DN15, NF norm
Connection thread: M30×1,5 mm
Max. working temperature: 120 °C
Max. working overpressure: PN10

T- turns	0,25	0,5	1,0	1,5	2,0	3,0	4,0
k _v (m³/h)	0,13	0,22	0,43	0,65	0,85	1,25	1,7








FLTIO-09 24V CROSS-FLOW FAR CONVECTION





PARAMETERS

	Width	270 mm
	Height	90 mm
	Length	800-4800 mm in step 400 mm
Convector	Height adjusting	0-35 mm
	Stainless trough width	250
	Grill type	cross / linear
	Grill material	anodized aluminium, wood, stainless steel
	Width	1 - 00 - 15
	Height	1 × Ø 65 mm
xchanger	Finned length	L-380 mm
xcnanger	Heat medium connection	2 × G1/2" female thread
	Max. working temperature	110 °C
	Max. working overpressure	1 MPa
	Rotor diameter	Ø 40 mm
Fan	Operating voltage	Safe voltage 24V DC
run:	Ingress protection	IP20
	Regulation	control voltage 0-10V (regulation SR201,)
Operating	Ambient temperature	+2 to +40°C
onditions	Relative humidity	20-70%

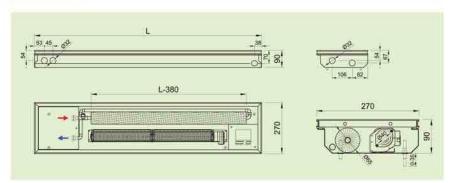

	CDEED	LENGTH [mm]										
	SPEED	800	1200	1600	2000	2400	2800	3200	3600	4000	4400	4800
ACOUSTIC	1.	22	24	24	25	25	25	25	25	26	26	26
PRESSURE	2	24	25	27	28	29	31	31	31	31	31	31
LpAmax [dB(A)]	3	30	30	33	34	37	39	39	39	39	39	40
AIR	1	27	55	82	109	137	164	191	219	246	273	301
VOLUME	2	36	65	92	130	184	196	250	276	315	369	380
[m³/h]	3	50	103	140	207	280	310	383	419	486	559	590

Code example FLT10-09200-NR126 Floor convector FLT10-09, H=90 mm, W=270 mm, L=2000 mm, stainless steel trough, Al natur frame, Al natur linear grill, installed regulation SR201, convector 24V DC

Ordering, see the page 44

SPECIFICATIONS

- Residence, luxury villas, houses, office buildings
- Forced convection by tangential fans
- High heating output
- · Low power consumption
- Safe voltage 24V DC
- Easy control
- Cu-Cu heat exchanger
- · Mechanical resistance of the heat exchanger
- Easy cleaning hygiene
- · Smooth running
- Using in dry ambience

HEATING OUTPUT

Q [W] 90/70/20°C

SPEED	0	1	2	3
rpm	0	576	762	1057
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	70	268	320	393
1200	136	536	640	786
1600	202	804	961	1179
2000	268	1073	1281	1572
2400	334	1609	1921	2358
2800	401	1670	1982	2419
3200	467	2145	2561	3144
3600	533	2413	2882	3537
4000	599	2681	3202	3930
4400	666	3218	3842	4716
4800	732	3279	3904	4778

Qn [W] 75/65/20°C

SPEED	0	1	2	3
rpm	0	576	762	1057
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	53	219	262	321
1200	104	438	523	642
1600	155	657	785	963
2000	206	876	1046	1284
2400	257	1314	1569	1926
2800	308	1364	1619	1976
3200	359	1752	2092	2568
3600	410	1971	2354	2889
4000	461	2190	2615	3210
4400	512	2628	3138	3852
4800	563	2678	3188	3902

Q [W] 70/55/20°C

SPEED	.0	1	2	3
rpm	0	576	762	1057
LENGTH [mm]		HEATING C	DUTPUT [W]	
800	42	183	218	268
1200	83	366	437	536
1600	123	549	655	804
2000	163	731	873	1072
2400	203	1097	1310	1608
2800	244	1139	1351	1649
3200	284	1463	1747	2144
3600	324	1646	1965	2412
4000	364	1828	2183	2680
4400	405	2194	2620	3216
4800	445	2236	2662	3258

Q [W] 55/45/20°C

SPEED	0	1	2	3
tpm	0	576	762	1057
LENGTH [mm]		HEATING C	DUTPUT [W]	
800	26	124	148	182
1200	50	248	297	364
1600	74	373	445	546
2000	99	497	593	728
2400	123	745	890	1092 1120
2800	147	773	918	
3200	172	994	1186	1456
3600	196	1118	1335	1638
4000	220	1242	1483	1820
4400	245	1490	1780	2185
4800	269	1519	1808	2213

FLT20-09 24V CROSS-FLOW FAN CONVECTIONS



SPECIFICATIONS

- Residence, luxury villas, houses, office buildings
- · Forced convection by tangential fans
- · High heating output
- · Low power consumption
- Safe voltage 24V DC
- Easy control
- · Cu-Cu heat exchanger
- · Mechanical resistance of the heat exchanger
- Easy cleaning hygiene
- · Smooth running
- Using in dry ambience

HEATING OUTPUT

Q [W] 90/70/20°C

SPEED	0	1	2	3
tpm	0	576	762	1057
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	170	661	673	687
1200	311	1323	1346	1374
1600	453	1984	2019	2060
2000	594 26	2646	2692 4037 4172	2747 4121 4255 5494
2400	735	3969		
2800	877	4103		
3200	1018	5292	5383	
3600	1160	5953	6056	6181
4000	1301	6615	6729	6868
4400	1442	7938	8075	8242
4800	1584	8072	8209	8376

Qn [W] 75/65/20°C

SPEED	0	Ť	2	3
rpm	0	576	762	1057
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	130	535	545	556
1200	239	1071	1089	1112
1600	348	1606	1634	1667
2000	456	2141	2178	2223
2400	565	3212	3267	3335
2800	674	3320	3376	3443
3200	783	4282	4356	4446
3600	891	4817	4901	5002
4000	1000	5353	5445	5558
4400	1109	6423	6534	6669
4800	1217	6532	6643	6778

Q [W] 70/55/20°C

SPEED	0	1	2	3
rpm	0	576	762	1057
ENGTH [mm]		HEATING C	[W] TUPTUC	
800	103	443	451	460
1200	189	886	902	920
1600	275	1330	1353	1380
2000	361	1773 2659 2749 3546	1803 2705 2795 3607	1841 2761 2851 3681 4141 4602
2400	447			
2800	533			
3200	619			
3600	705	3989	4058	
4000	791	4432	4509	
4400	877	5318	5410	5522
4800	963	5408	5500	5612


Q [W] 55/45/20°C

SPEED	0	î î	2	3
rpm	0	576	762	1057
LENGTH [mm]		HEATING C	[W] TUPTUC	
800	62	296	301	307
1200	114	591	602	614
1600	166	887	903	921
2000	218	1183	1203	1228
2400	270	1774	1805	1842
2800	322	1835	1865	1903
3200	374	2366	2407	2457
3600	426	2662	2708	2764
4000	478	2957	3009	3071
4400	530	3549	3610	3685
4800	582	3609	3670	3745



PARAMETERS

	Width	320 mm			
	Height	90 mm			
	Length	800-4800 mm in step 400 mm			
Convector	Height adjusting	0~3.5 mm			
	Stainless trough width	300 mm			
	Grill type	cross / linear			
	Grill material	anodized aluminium, wood, stainless steel			
	Width	2 × Ø 65 mm			
	Height	2 * 10 63 mm			
	Finned length	L-320 mm			
Exchanger	Heat medium connection	2 × G1/2" female thread			
	Max. working temperature	110 °C			
	Max. working overpressure	1 MPa			
	Rotor diameter	Ø 40 mm			
Fan	Operating voltage	Safe voltage 24V DC			
(Fan	Ingress protection	IP20			
	Regulation	control voltage 0-10V (regulation SR201,)			
Operating	Ambient temperature	+2 to +40°C			
conditions	Relative humidity	20-70%			

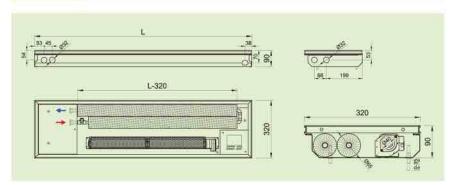

	SPEED	LENGTH [mm]										
	SPEED	800	1200	1600	2000	2400	2800	3200	3600	4000	4400	4800
ACOUSTIC	1	22	24	24	25	25	25	25	25	26	26	26
PRESSURE	2	24	25	27	28	29	31	31	31	31	31	31
LpAmox [dB(A)]	3	30	30	33	34	37	39	39	39	39	39	40
AIR	1	26	53	80	107	134	160	187	214	240	267	294
VOLUME	2	35	64	90	128	180	191	244	270	308	361	372
[m³/h]	3	49	101	137	202	273	303	375	410	476	547	577

Code example FLT20-09120-NR116 Floor convector FLT20-09, H=90 mm, W=320 mm, L=1200 mm, stainless steel trough, Al natur frame, Al natur cross roll-up grill, installed regulation SR201, convector 24V DC

Ordering, see the page 44


FLTIO-II 24V CROSS-FLOW FAN CONVECTION





PARAMETERS

	Width	270 mm		
	Height	11.5 mm		
	Length	800-4800 mm in step 400 mm		
Convector	Height adjusting	0-35 mm		
Stainless trough width		250 mm		
	Grill type	crass / linear		
	Grill material	anodized aluminium, wood, stainless steel		
	Width	1 × Ø 65 mm		
	Height	1 ~ 52 63 11111		
Exchanger	Finned length	L-440 mm		
exchanger	Heat medium connection	2 × G1/2" female thread		
	Max. working temperature	110 °C		
	Max. working overpressure	1 MPa		
	Rotor diameter	Ø 60 mm		
Fan	Operating voltage	Safe voltage 24V DC		
run:	Ingress protection	IP20		
	Regulation	control voltage 0-10V (regulation SR201,)		
Operating	Ambient temperature	+2 to +40 °C		
conditions	Relative humidity	20-70%		

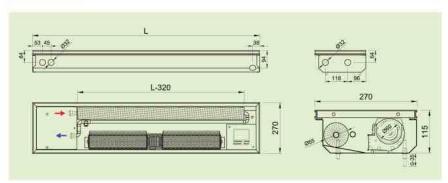

	SPEED	LENGTH [mm]										
		800	1200	1600	2000	2400	2800	3200	3600	4000	4400	4800
ACOUSTIC	1	19	21	23	23	23	24	24	24	24	25	25
PRESSURE	2	26	27	28	28	30	31	32	32	33	33	33
LpAmas [dB(A)]	3	3.5	3.5	36	37	39	40	40	40	40	40	41
AIR	1	28	56	84	113	141	169	197	225	253	281	309
VOLUME	2	37	80	117	159	197	239	277	319	357	400	437
[m³/h]	3	51	117	168	234	285	351	402	468	519	585	636

Code example FLT10-11080-NR215 Floor convector FLT10-11, H=115 mm, W=270 mm, L=800 mm, stainless steel trough, Al bronze frame, Al bronze cross roll-up grill, without regulation, convector 24V DC

Ordering, see the page 44

SPECIFICATIONS

- Residence, luxury villas, houses, office buildings
- · Forced convection by tangential fans
- High heating output
- Low power consumption
- Safe voltage 24V DC
- Easy control
- Cu-Cu heat exchanger
- · Mechanical resistance of the heat exchanger
- Easy cleaning hygiene
- · Smooth running
- Using in dry ambience

HEATING OUTPUT

Q [W] 90/70/20°C

SPEED	0	1	2	3
rpm	0	465	582	756
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	100	233	284	354
1200	183	465	569	708
1600	267	698	853	1062
2000	350	930	1138	1416
2400	433	1163	1422	1769
2800	517	1395	1706	2123
3200	600	1628	1991	2477
3600	683	1861	2275	2831
4000	767	2093	2559	3185
4400	850	2326	2844	3539
4800	933	2558	3128	3893

Qn [W] 75/65/20°C

SPEED	0	1	2	3
rpm	0	465	582	756
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	77	191	233	290
1200	141	382	467	581
1600	205	572	700	871
2000	269	763	933	1161
2400	333	954	1166	1451
2800	397	1145	1400	1742
3200	461	1335	1633	2032
3600	525	1526	1866	2322
4000	589	1717	2099	2612
4400	653	1908	8 2333	
4800	717	2098	2566	3193

Q [W] 70/55/20°C

SPEED	.0	1	2	3
rpm	0	465	582	756
LENGTH [mm]		HEATING C	[W] TUPTUC	
800	61	160	195	243
1200	111	320	391	486
1600	162	480	586	730
2000	213	639	782	973 1216 1459
2400	263	799	977	
2800	314	959	1173	
3200	365	1119	1368	1703
3600	415	1279	1564	1946
4000	466	1439	1759	2189
4400	517	1599	1955	2432
4800	567	1758	2150	2676

Q [W] 55/45/20°C

SPEED	0	1	2	3
1pm	0	465	582	756
LENGTH [mm]		HEATING C	DUTPUT [W]	
800	37	109	134	167
1200	67	219	268	333
1600	98	328	402	500
2000	129	438	535	666
2400	159	547	669	833
2800	190	657	803	999
3200	221	766	937	1166
3600	251	876	1071	1333
4000	282	985	1205	1499
4400	312	1095	1339	1666
4800	3.43	1204	1472	1832



SPECIFICATIONS

- Residence, luxury villas, houses, office buildings
- · Forced convection by tangential fans
- · High heating output
- · Low power consumption
- Safe voltage 24V DC
- Easy control
- · Cu-Cu heat exchanger
- · Mechanical resistance of the heat exchanger
- Easy cleaning hygiene
- · Smooth running
- Using in dry ambience

HEATING OUTPUT

Q [W] 90/70/20°C

SPEED	0	1	2	3
tpm .	0	465	582	756
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	185	478	558	693
1200	339	956	1117	1387
1600	493	1435	1675	2080
2000	647	1913	2234	2774
2400	800	2391	2792	3467
2800	954	2869	3350	4160
3200	1108	3347	3909	4854
3600	1262	3826	4467	5547
4000	1416	4304	5026	6240
4400	1570	4782	5584	6934
4800	1724	5260	6142	7627

Qn [W] 75/65/20°C

SPEED	0	Ť	2	3
rpm	0	465	582	756
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	142	395	461	573
1200	260	790	923	1146
1600	379	1185	1384	1718
2000	497	1580	1845	2291
2400	615	1975	2306	2864
2800	734	2370	2768	3437
3200	852	2765	3229	4009
3600	970	3160	3690	4582
4000	1088	3555	4151	5155
4400	1207	3950	4613	5728
4800	1325	4345	5074	6300

Q [W] 70/55/20°C

SPEED	0	1	2	3
rpm	0	465	582	756
LENGTH [mm]		HEATING C	[W] TUPTUC	
800	112	333	389	483
1200	206	666	778	966
1600	299	999	1167	1449
2000	393	1332	1556	1932
2400	487	1666	1945	2415
2800	580	1999	2334	2898
3200	674	2332	2723	3381
3600	767	2665	3112	3864
4000	861	2998	3501	4347
4400	954	3331	3890	4830
4800	1048	3664	4279	5313


Q [W] 55/45/20°C

SPEED	0	1	2	3
rpm	0	465	582	756
LENGTH [mm]		HEATING C	DUTPUT [W]	
800	68	231	270	335
1200	125	462	540	671
1600	181	694	810	1006
2000	238	925	1080	1341
2400	294	1156	1350	1676
2800	351	1387	1620	2012
3200	407	1619	1890	2347
3600	464	1850	2160	2682
4000	521	2081	2430	3017
4400	577	2312	2700	3353
4800	634	2543	2970	3688



PARAMETERS

	Width	320 mm
	Height	115 mm
xchanger	Length	800-4800 mm in step 400 mm
	Height adjusting	0-35 mm
	Stainless trough width	300 mm
	Grill type	cross / linear
	Grill material	anodized aluminium, wood, stainless steel
xchanger	Width	2 × Ø 65 mm
	Height	2 × 10 03 mm
	Finned length	L320 mm
	Heat medium connection	2 × G1/2" female thread
	Max. working temperature	110 °C
	Max. working overpressure	1 MPa
	Rotor diameter	Ø 60 mm
- 31	Operating voltage	Safe voltage 24V DC
run	Ingress protection	IP20
	Regulation	control voltage 0-10V (regulation SR201,)
perating	Ambient temperature	+2 to +40 °C
onditions	Relative humidity	20-70%

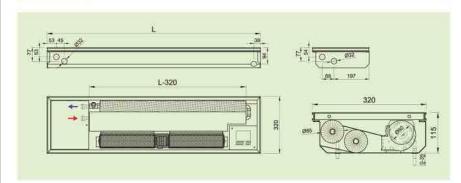

	SPEED		LENGTH [mm]										
	SPEED	800	1200	1600	2000	2400	2800	3200	3600	4000	4400	4800	
ACOUSTIC	1	19	21	23	23	23	24	24	24	24	25	25	
PRESSURE	2	26	27	28	28	30	31	32	32	33	33	33	
L _{PAmerx} [dB(A)]	3	3.5	35	36	37	39	40	40	40	40	40	41	
AIR VOLUME [m³/h]	1	27	56	83	112	139	167	195	223	251	279	307	
	2	37	79	116	158	195	237	275	316	354	396	433	
	3	51	116	167	232	283	348	398	464	514	580	630	

Code example FLT20-11320-NR126
Floor convector FLT20-11, H=115 mm, W=320 mm, L=3200 mm, stainless steel trough, Al natur frame, Al natur linear grill, installed regulation SR201, convector 24V DC

Ordering, see the page 44

HEATING/COOLING CONVECTORS 24V DC



Floor convectors equipped with tangential fans excel in heating and cooling output. They are proper complements of cooling devices and airconditioning, influence of which does not reach up to window surfaces.

Convector is fitted with Al-Cu lamellar exchanger through which heating medium is flowing. Lengthwise placed tangential fans guarantee a balanced exchanger covering and subsequently an optimized heat distribution to the room.

A version of the exchanger for 2-pipe and 4-pipe systems. The convectors may be equipped with a pump of condensate that occurs at cooling.

- · High heating/cooling output
- . Energy saving fans 24V DC
- · Continuous revs regulation
- · Possible to be completed with a condensate pump

TYPES FCC 24V DC:

FCC2A (320×134×1200–2800 mm) 2 pipe system FCC4A (320×134×1200–2800 mm) 4 pipe system

24V DC FANS

The installed modern fans with EC engines work under the operating voltage of 24 V DC. The continuous engine revs regulation 0-10V enables accurate control of floor convector output. Power consumption of a fan is specified in watt units. Only one thermostat and one regulator is sufficient for all convectors installed in a standard room.

TABLE OF CONVECTOR ELECTRIC POWER INPUTS

- Convectors are equipped with continuously speed regulated 24V DC fans
- Recommended FCT floor convectors regulation is in the range of 0 10V

TABLE OF ELECTRIC POWER INPUTS OF FCC 24 V DC CONVECTORS

TYPE	Speed	FCC convector length [mm]								
TIPE	Speed	1200	1600	2000	2400	2800				
	1	4 W	6 W	6 W	8 W	8 W				
Tanama a T	2	6W	10 W	10 W	13 W	13 W				
FCC2A	3	11 W	20 W	20 W	29 W	29 W				
FCC4A	4	18 W	33 W	33 W	48 W	48 W				
	5	23 W	43 W	43 W	63 W	63 W				

input power of installed fans, speed regulator and power supply

Add considered accessories to the power input of FCC:

Thermo-drive:


+6 VA power input at switching-on (operation consumption is 2.5 W)

Condensate pump:

+16 W (switching-on at sufficient amount of condensate)

RECOMMENDED STANDARD INSTALLING IN FLOOR

Convector installation with exchanger towards window, ideal position 100-200 mm distance from window, fan draws in the room air.



CONVECTOR FUNCTIONS


Heating:

- · the air is warmed up by flowing through exchanger
- hot air is mixed with cold air flowing off the window surface
- · air circulation:
 - warms up the room air
 - screens the window surface
 - secondary demisters the window surface

Cooling:

- · air is cooled by flowing through the exchanger
- · cool air is mixed with warm air rising up on a window surface
- condensate occurs with low temperatures of cooling water, that is drained out of the convector
- · air circulation:
 - it cools air in the area of the window surface
 - it decreases radiation of the window surface
- · only local cooling
- it does not replace but completes the cooling device or air-conditioning, influence of which does not reach up to the window surfaces

CONVECTOR CONNECTION TO THE HEATING SYSTEM

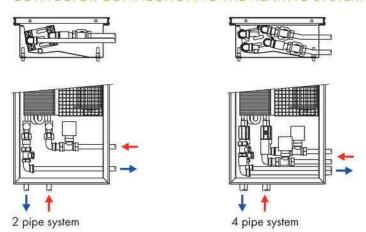

The floor convector is provided with entry holes for connection to the heating system. Connection is possible from the face side and from the side to the room.



HEATING OUTPUT RECALCULATION FOR ANOTHER TEMPERATURE GRADIENT

Convector heating output reckoning follows by recalculation of the standardized output Qn $75/65/20~^{\circ}\text{C}$

$$Q = Qn * \Psi * \left(\frac{\Delta T}{50}\right)^m \text{ [W]; kde } \Delta T = \left(\frac{T1 + T2}{2}\right) - Ti \text{ [°C]}$$

m=1,015 for FCC2A, FCC4A

Qn	[W]	heating output for temperature gradient
	1207121	T1/T2/Ti = 75/65/20 °C
Ψ	[-]	mass rate of flow coefficient (for current flow rate $\psi=1$)
T1	[°C]	input water temperature
T2	[°C]	output water temperature
Ti	[°C]	temperature in the room
m	[-]	temperature exponent

QUICK CONVERSION TO TI=22 °C A TI=15 °C FOR ORIENTATION

- If you want to learn convector output for the room temperature of 22 °C or for a corridor temperature of 15°C
- multiply heating output of the chosen convector by the " \mathbf{k} " coefficient

For Ti=22°C, k=0.95 E.g.: Q [55/45/22 °C] = 0.95 * Q [55/45/20 °C]

for Ti=15°C, k=1.12

E.g.: Q [75/65/15 °C] = 1.12 * Qn [75/65/20 °C]

COOLING OUTPUTS

Cooling outputs for the common used temperature gradients are shown in the tables for each type of FCC. To get outputs on other parameters please contact the technical department.

HEATING WATER FLOW RATE THROUGH EXCHANGER

M = 0.86Q/(T1-T2) [kg/h]

M [kg/h] mass rate of flow, heating water flowing through exchanger

Q [W] convector heating output

T1-T2 [°C] difference between input and output temperature

0.86 [-] invariable for recalculation of units

CONVECTOR DIMENSIONING BASED ON ACOUSTIC PARAMETERS

- Convector heating output must cover thermal loss in the room and observe the acoustic parameters
- · Permissible noisiness levels are determined by national legislation
- Different values of permissible noisiness levels are valid for residential houses, hospitals, offices, hotels etc.
- Heating output of convector with fan is designed for revolutions conforming with the lowest admissible acoustic pressure level in the room
- Tables of acoustic pressure L_{pAmax} [dB(A)] are in chapters relating to the single floor convector types
- Quoted measuring of acoustic parameters follows diagonally in the distance of 1m above and 1m in front of the convector
- The acoustic field may differ in dependence on:
 - convector placing in the room and its appropriate installation
 - the room space and segmentation (corners, partitions, ceiling)
 - furnishings as absorbing elements: tables, chairs, cupboards, wardrobes, carpets etc.
- installation of more convectors in one room
- sometimes, e.g. when convector is placed in a corner, the noisiness parameters may show values increased by 3dB(A)

EXCHANGER HYDRAULIC LOSSES

	-D DEE	Length	Volume		,	-	N	- mass r	ate of flo	w în pipir	ng (kg/h)	/R - hyd	draulic los	s in exch	anger (kP	Pa)			
	Typ FCC	[mm]	[1]	M=50	60	70	80	90	100	120	150	200	250	300	350	400	450	500	550
E		1200	0,647	0,14	0,17	0,21	0,25	0,30	0,35	0,46	0,66	1,07	1,58	2,19	2,91	3,72	4,63	5,64	6,75
system	FCC2A 1600	1600	0,934	0,20	0,25	0,30	0,37	0,43	0,50	0,67	0,96	1,55	2,29	3,18	4,21	5,38	6,70	8,16	9,77
(\$ 9	heating and	2000	1,257	0,27	0,34	0,41	0,49	0,58	0,68	0,90	1,29	2,09	3,09	4,28	5,67	7,26	9,03	11,01	13,18
pipe	cooling	2400	1,582	0,34	0,42	0,52	0,62	0,73	0,86	1,13	1,62	2,64	3,89	5,40	7,15	9,14	11,38	13,87	16,60
6		2800	1,868	0,40	0,50	0,61	0,73	0,87	1,02	1,34	1,92	3,12	4,61	6,39	8,46	10,83	13,48	16,43	19,67
	1200	0,202	0,49	0,68	0,89	1,12	1,38	1,65	2,27	3,37	5,64	8,45	11,82	15,73	20,20	25,22	30,78	36,90	
		1600	0,297	0,71	0,99	1,30	1,64	2,01	2,41	3,32	4,92	8,23	12,35	17,26	22,98	29,51	36,84	44,97	53,90
	FCC4A	2000	0,405	0,97	1,34	1,76	2,22	2,73	3,28	4,51	6,69	11,19	16,78	23,46	31,24	40,10	50,06	61,11	73,26
E E	heating circle	2400	0,512	1,22	1,69	2,22	2,80	3,44	4,13	5,68	8,42	14,08	21,12	29,53	39,32	50,48	63,02	76,93	92,21
system		2800	0,609	1,44	2,00	2,62	3,31	4,07	4,89	6,72	9,96	16,66	24,98	34,94	46,51	59,72	74,55	91,00	109,08
pipe		1200	0,409	0,16	0,23	0,31	0,39	0,48	0,58	0,81	1,20	2,00	2,99	4,18	5,56	7,12	8,88	10,83	12,97
4 Pi		1600	0,599	0,24	0,34	0,45	0,57	0,70	0,85	1,17	1,74	2,90	4,34	6,07	8,06	10,34	12,89	15,72	18,83
	FCC4A	2000	0,816	0,32	0,45	0,60	0,77	0,95	1,14	1,58	2,35	3,92	5,87	8,20	10,90	13,98	17,43	21,25	25,45
	cooling circle	2400	1,029	0,40	0,57	0,76	0,97	1,20	1,45	2,00	2,97	4,97	7,44	10,38	13,80	17,70	22,07	26,91	32,23
		2800	1,223	0,48	0,69	0,91	1,16	1,44	1,73	2,39	3,55	5,94	8,90	12,42	16,51	21,17	26,40	32,19	38,56

PARAMETERS OF LOCKSHIELD VALVES

T-turns	0,5	0,75	1.	1,5	2	2,5	3	3,5	4	5	6	MAX
Kv (m³/h) - direct version	0,3	0,4	0,55	0,75	0,91	1,05	1,25	1,33	1,4	1,6	1,7	1,8
Kv (m³/h) - corner version	0,2	0,25	0,29	0.4	0,5	0,69	0,8	1	1.2	1,55	1.9	2.2

parameters of free packed in lockshield valves




Regulation of floor convector with installed power saving 24V DC fans enables to utilize a modern control technology. Convector becoming a part of the heating system evaluates the situation and reacts to outer incentives. By means of very simple control and due to antifreeze protection eliminating any heat leakage, the heated room has all precon-

ditions for comfortable dwelling. The regulator power consumption is negligible. Communication between floor convector and thermostat follows by data flow based on CIB protocol. The system may be easily integrated in Foxtrot-BMS. Modifications for LonWorks, EIB, KNX and others are available to order.

REGULATION BY MEANS OF RTM 101 THERMOSTAT AND INSTALLED SR201 REGULATOR

TEMPERATURE SETTING UP



15-30 °C range for heating ∗ ∗ ⋄ ⋄ ⋄ range for cooling

The system automatically changes between heating / cooling in dependence on ambient temperature and according to the temperature of heating medium flowing through exchanger. The medium flowing and the fans are stopped, as soon as the desired temperature in the room is reached.

Modes:

OFF convector off

AUTO automated regulation of floor convector detecting the actual room temperature; the mode regulates continuous revs adjustment of fans, watches over the exchanger temperature, switches between heating and cooling, reacts to window sensors

TEMP moderate heating, the fans are off, only the flow rate of heating medium is active

1-5 continuous fan revs regulation according to the user's demand

Sleep mode (


Decreases the demand for thermostat setting by -2 °C (heating) or +2 °C (cooling). It is not necessary to reset the thermostat parameters for the night or for a period of absence in the house. The sleep mode is signalized by LED diode on the thermostat cover.

Antifreeze protection

Regulator switches on a thermal actuator when the local temperature drops below $5\,^{\circ}$ C around the floor convector. So, the heating medium flowing through exchanger prevents any system damage. The antifreeze protection functions within all mode options, inclusively the OFF-mode. The antifreeze protection is only available, when the heating system is supplied with heating medium.

Window sensors

In case of installed window sensor, regulator stops the convector running during ventilation. The antifreeze protection remains active and after the window is closed, system returns to the standard mode.

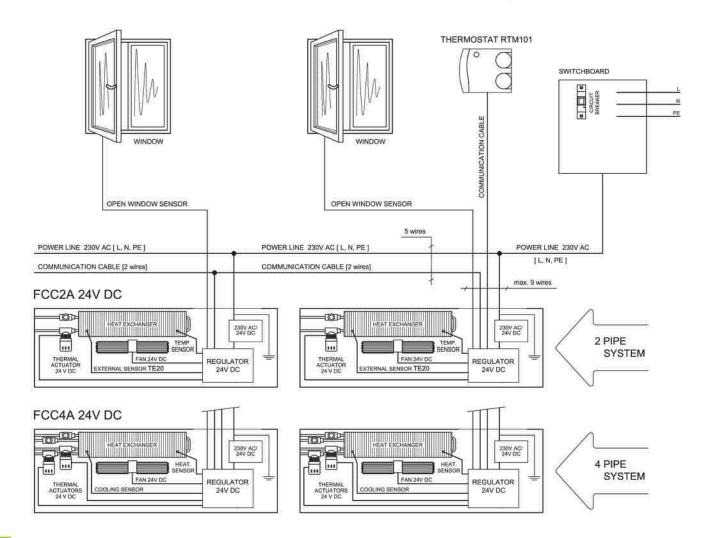

ACCESSORIES FOR FCC 24V DC



RTM101

Room thermostat, heating/cooling, continuous revs regulation, sleep mode, OFF, AUTO and TEMP modes,

continuous revs range 1-5

Colour: white

Communication: CIB protocol

CIB parameters: 24V DC; 2.2W

Dimension: 98×106×34 mm

Ingress protection: IP30



Z-TS24, Z-TS24-5m, thermal actuator

Input voltage: 24V DC

Power input when switch on: 6VA

Power input during operating: 2.5W

Period of switching ON/OFF: 270 s


Ingress protection: IP54 (housing)

Connection thread: M30×1.5mm

 Cable length:
 Z-TS24
 3 meters

 Z-TS24-5m
 5 meters

Max. height when opened: 74 mm



TE20 (only for FC2A)

External temperature sensor as "antifreeze protection"
Sensor type: thermistor

Temperature range: from -30 °C to 90 °C

Cable length: 5 m

Connection: by 2 cables



DF10

Filter of fan suction

Colour: black

Filter dimensions: please mention in the order the length of the FCC convector

(e.g. DF10 for FCC I=2000 mm)



CP10

A membrane pump of condensate that may occur at cooling, connection to the convector drain pipe

 Operation voltage:
 230 V/50 Hz

 Power input:
 16 W / 0.17 A

Max. recommended delivery: 10 m

Capacity I/h: 12 | (0 m) - 4.5 | (10 m)

Acoustic pressure at delivery of 1 m: 21 dB(A)

Voltage-free contact - alarm: 3 A induction, contacts N.O., N.C.



Z-TD001 direct, Z-TE001 corner

Thermostatic valve installed on the exchanger input tube regulates the flow rate of heating medium through the heat exchanger

Dimension: DN15, NF norm
Connection thread: M30×1.5mm
Operating temperature, max. 120 °C
Operating pressure, max. PN10

Valve adjusting	1	2	3	4	5	N	
k, (m³/h)	0,1	0,2	0,31	0,45	0,69	0,89	



Z-RD002 direct, Z-RE002 corner

Lockshield valves

Dimension: DN15, NF norm
Connection thread: M30×1,5 mm
Max. working temperature: 120 °C
Max. working overpressure: PN10

T- turns	0,25	0,5	1,0	1,5	2,0	3,0	4,0
k _v (m ³ /h)	0,13	0,22	0,43	0,65	0,85	1,25	1,7



Note: A speed controller and a power supply are always parts of the FCC floor convector


FCC2A-13 24V CROSS-FLOW FAN CONVECTION





PARAMETERS

	Width	320 mm
	Height	134 mm
	Length	1200-2800 mm in step 400 mm
Convector	Height adjusting	0-35 mm
	Stainless trough width	280 mm
	Grill type	cross / linear
	Grill material	anodized aluminium, wood, stainless steel
	Width	100 mm
	Height	65 mm
Finkanan	Finned length	L-465 mm
Exchanger	Heat medium connection	2 × G1/2" female thread (2 pipe system)
	Max. working temperature	110 °C
	Max. working overpressure	1 MPa
	Rotor diameter	Ø 60 mm
Fan	Operating voltage	input to convector 230V AC, fans 24V DC
ran	Ingress protection	IP20
	Regulation	control voltage 0-10V (installed regulation)
Operating	Ambient temperature	+2 to +40 °C
conditions	Relative humidity	20-70 %

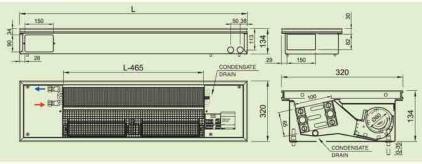

	SPEED			LENGTH [mm]		
	SPEED	1200	1600	2000	2400	2800
	1	<20	<20	<20	<20	<20
ACOUSTIC	2	20	22	25	25	25
PRESSURE	3	30	32	34	35	36
Lpamas [dB(A)]	4	40	42	44	45	46
	5	48	49	51	52	53
	1	47	66	100	114	147
AIR	2	89	123	179	195	266
VOLUME	3	134	191	266	336	394
[m³/h]	4	179	255	356	449	526
	5	212	302	422	532	624

Code example FCC2A-13200-NR127

Floor convector FCC2A-13, H=134 mm, W=320 mm, L=2000 mm, stainless steel trough, Al natur frame, Al natur linear grill, installed regulation, convector with fans 24V DC

Regulation is always a part of the convector, black covers of water and electricity. Ordering, see the page 44

SPECIFICATION

- Fully glazed rooms with big heat gains
- Flats, villas, residences, hotels
- High heat output
- Optimum after-cooling output
- · Convection with tangential fans
- Silent operation
- · Dry environment
- Safety voltage 24 V
- · Low consumption of electric energy
- Easy operation

HEATING OUTPUT

Q [W] 90/70/20°C

Speed level	Minimal	S	tandard lev	el	Maximal
SPEED	1	2	3	4	5
LENGTH [mm]		HEATIN	IG OUTPUT	[W],	
1200	645	1466	2408	3115	3591
1600	967	2198	3612	4673	5386
2000	1290	2931	4816	6231	7181
2400	1612	3664	6019	7788	8977
2800	1935	4397	7223	9346	10772

Qn [W] 75/65/20°C

Speed level	Minimal	S	tandard lev	el	Maximal
SPEED	ĭ	2	3	4	5
LENGTH [mm]		HEATIN	IG OUTPU	[W],,O	
1200	536	1218	2001	2589	2984
1600	804	1827	3002	3884	4476
2000	1072	2436	4002	5178	5968
2400	1340	3045	5003	6473	7460
2800	1608	3654	6003	7767	8952

Q [W] 70/55/20°C

Speed level	Minimal	S	tandard lev	el	Maximal
SPEED	1	2	3	4	5
LENGTH [mm]		HEATIN	IG OUTPU	Q,[W]	
1200	454	1033	1697	2195	2530
1600	682	1549	2545	3293	3795
2000	909	2066	3393	4391	5060
2400	1136	2582	4242	5488	6326
2800	1363	3098	5090	6586	7591

Q [W] 55/45/20°C

Speed level	Minimal	S	tandard lev	el	Maximal
SPEED	1	2	3	4	5
LENGTH [mm]		HEATIN	IG OUTPU	[W],O	
1200	319	725	1191	1542	1777
1600	479	1088	1787	2312	2665
2000	638	1450	2383	3083	3553
2400	798	1813	2979	3854	4442
2800	957	2176	3574	4625	5330

FCC2A-I3 24V CROSS-FLOW FAN CONVECTION



Q [W] 6/12 °C

Sp	eed le	vel	Min	imal			Standa	rd level			Max	kimal
	SPEED		1		2 3					4		5
LENGTH	TitleCl	r.v.[%]				COC	DUNG	DUTPUT	[W]			
[mm]	Ti[°C]	TATAL	Ok[W]	Qs[W]	Ok[W]	Qs[W]	Qk[W]	Q ₁ [W]	Ok[W]	Qs[W]	Qk[W]	Qs[W]
	30	45	183	117	547	356	1119	740	1300	880	1520	1047
1200	28	50	170	106	508	322	1038	669	1206	794	1410	943
1200	26	50	140	95	415	287	847	598	985	712	1148	847
	24	50	110	83	326	252	661	524	773	627	898	747
	30	45	274	175	820	534	1678	1110	1950	1320	2280	1571
1400	28	50	256	160	762	483	1557	1003	1810	1191	2115	1415
1600	26	50	210	143	623	431	1270	896	1478	1068	1722	1271
	24	50	165	124	489	377	992	786	1159	941	1346	1120
	30	45	365	233	1093	711	2238	1481	2600	1761	3040	2095
2020	28	50	341	213	1016	644	2076	1338	2413	1587	2820	1886
2000	26	50	280	190	831	574	1694	1195	1970	1424	2296	1694
	24	50	220	166	652	503	1323	1049	1545	1255	1795	1493
	30	45	456	292	1366	889	2797	1851	3249	2201	3800	2619
0.400	28	50	426	266	1270	805	2595	1672	3016	1984	3525	2358
2400	26	50	351	238	1039	718	2117	1494	2463	1780	2870	2118
	24	50	275	207	814	629	1653	1311	1931	1568	2244	1867
	30	45	548	350	1640	1067	3357	2221	3899	2641	4560	3142
2000	28	50	511	319	1524	966	3114	2007	3619	2381	4230	2829
2800	26	50	421	285	1246	862	2541	1793	2956	2136	3444	2542
	24	50	330	248	977	755	1984	1573	2318	1882	2693	2240

Q [W] 12/16 °C

Sp	eed le	vel	Min	imal			Standa	rd level			Max	kimal
	SPEED	EED 1 2		Ş	3 4				5			
ENGTH	7-11-01	- 16/A				CO	DUNG (OUTPUT	[W]			
[mm]	Ti[°C]	7.y.[%]	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Q ₀ [W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	30	45	114	88	337	268	686	563	802	685	935	821
1200	28	50	101	76	297	233	603	491	708	597	823	714
1200	26	50	69	64	200	198	441	441	539	539	635	635
	24	50	58	58	175	175	369	369	448	448	528	528
	30	45	171	131	506	402	1029	845	1204	1028	1402	1231
1700	28	50	151	114	445	350	905	736	1062	896	1234	1072
1600	26	50	103	96	299	296	662	662	808	808	952	952
	24	50	88	88	263	263	554	554	672	672	791	791
	30	45	228	175	675	536	1372	1127	1605	1370	1869	1641
2000	28	50	201	152	594	467	1207	982	1416	1195	1645	1429
2000	26	50	137	128	399	395	883	883	1078	1078	1269	1269
	24	50	117	117	351	351	738	738	897	897	1055	1055
	30	45	285	219	843	670	1715	1408	2006	1713	2336	2052
0.400	28	50	252	191	742	583	1508	1227	1770	1494	2056	1786
2400	26	50	172	160	499	494	1104	1104	1347	1347	1587	1587
	24	50	146	146	439	439	923	923	1121	1121	1319	1319
	30	45	342	263	1012	804	2058	1690	2407	2055	2804	2462
0000	28	50	302	229	891	700	1810	1473	2124	1792	2468	2143
2800	26	50	206	192	599	593	1324	1324	1616	1616	1904	1904
	24	50	175	175	526	526	1108	1108	1345	1345	1583	1583

 $Qk\left[W\right]-total\ cooling\ output,\ Qs[W]-sensible\ cooling\ output\ RH[\%]-relative\ humidity$

CONDENSATE

If the cooling system is dimensioned so that condensate may occur (Qs<Qk), it is necessary to drain it from the convector. Condensate drips from lamellas of the exchanger to a drain chute, from which it flows out through a pipe on the convector right side. If condensate needs to be delivered to a collecting container or to a position above the convector, please use the condensate pump. Before use, check correct operation of the pump and its tightness by filling it with a small water amount through the exchanger. A float chamber must be cleaned from deposit dirt from time to time. Please follow instructions in the attached user manual.


Q [W] 8/14 °C

Sp	eed le	vel	Min	imal			Standa	rd level	d level		Max	imal
	SPEED		1	ì	2 3				3	4	: 4	5
LENGTH	Trinch	10/1				COC	DLING	OUTPUT	[W]			
[mm]	TI["C]	r.v,[%]	Qk[W]	Os[W]	Qk[W]	Qs[W]	QK[W]	Qs[W]	Ok[W]	$Q_{\delta}[W]$	Qk[W]	Qs[W]
	30	45	155	104	461	318	939	664	1094	796	1275	948
1200	28	50	142	93	421	283	857	591	1000	709	1163	842
1200	26	50	111	82	325	248	660	519	774	624	898	745
	24	50	78	69	229	209	465	441	554	537	678	678
	30	45	233	157	691	477	1409	996	1641	1193	1913	1422
1100	28	50	213	140	632	425	1286	886	1499	1064	1745	1264
1600	26	50	167	123	487	372	991	778	1162	937	1346	1117
	24	50	117	103	344	314	698	662	831	805	1018	1018
	30	45	311	209	921	636	1878	1328	2188	1591	2550	1896
2000	28	50	284	186	842	567	1715	1182	1999	1418	2326	1685
2000	26	50	222	164	650	495	1321	1037	1549	1249	1795	1490
	24	50	156	137	459	418	931	883	1108	1074	1357	1357
	30	45	388	261	1152	795	2348	1660	2735	1989	3188	2369
2400	28	50	355	233	1053	708	2143	1477	2499	1773	2908	2106
2400	26	50	278	205	812	619	1651	1296	1936	1561	2244	1862
	24	50	195	172	574	523	1163	1104	1385	1342	1696	1696
	30	45	466	313	1382	954	2817	1992	3282	2387	3825	2843
2000	28	50	426	280	1264	850	2572	1773	2999	2127	3489	2527
2800	26	50	333	246	974	743	1981	1556	2323	1873	2693	2234
	24	50	234	206	688	627	1396	1324	1662	1611	2035	2035

Q [W] 16/18 °C

Speed level		rel	Min	imal			Standa	rd level			Max	rimal
	SPEED		1	ı	2		3		4		5	
LENGTH	T-11-01	r.v.[%]				COC	DUNG	DUTPUT	[W]			
[mm]	0.[35]	EA[-0]	Ok[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W
	30	45	72	72	222	222	473	473	584	584	693	693
1000	28	50	61	61	189	189	402	402	495	495	587	587
1200	26	50	51	51	156	156	330	330	407	407	481	481
	24	50	40	40	122	122	259	259	317	317	374	374
	30	45	107	107	333	333	709	709	876	876	1039	1039
1/00	28	50	92	92	283	283	602	602	743	743	881	881
1600	26	50	76	76	234	234	495	495	610	610	722	722
	24	50	59	59	184	184	388	388	475	475	561	561
	30	45	143	143	443	443	946	946	1168	1168	1385	1385
2000	28	50	122	122	378	378	803	803	991	991	1175	1175
2000	26	50	102	102	312	312	660	660	814	814	962	962
	24	50	79	79	245	245	518	518	633	633	748	748
	30	45	179	179	554	554	1182	1182	1460	1460	1731	1731
	28	50	153	153	472	472	1004	1004	1239	1239	1468	1468
2400	26	50	127	127	390	390	825	825	1017	1017	1203	1203
	24	50	99	99	306	306	647	647	791	791	935	935
	30	45	215	215	665	665	1419	1419	1752	1752	2078	2078
0000	28	50	184	184	567	567	1205	1205	1486	1486	1762	1762
2800	26	50	152	152	468	468	991	991	1221	1221	1443	1443
	24	50	119	119	367	367	776	7.76	950	950	1121	1121

EXAMPLE OF CONNECTION OF A FLOOR CONVECTOR WITH A CONDENSATE PUMP




FCC 4A-13 24V CROSS-FLOW FAR CONVECTION





PARAMETERS

	Width	320 mm
	Height	134 mm
	Length	1200-2800 mm in step 400 mm
Convector	Height adjusting	0-35 mm
	Stainless trough width	280 mm
	Grill type	cross / linear
	Grill material	anodized aluminium, wood, stainless steel
	Width	100 mm
	Height	65 mm
S. S	Finned length	1-465 mm
Exchanger	Heat medium connection	4 × G1/2" female thread (4 pipe system)
	Max. working temperature	110 °C
	Max. working overpressure	1 MPa
	Rotor diameter	Ø 60 mm
Fan	Operating voltage	input to convector 230V AC, fans 24V DC
ran	Ingress protection	IP20
	Regulation	control voltage 0-10V (installed regulation)
Operating	Ambient temperature	+2 to +40 °C
conditions	Relative humidity	20-70 %

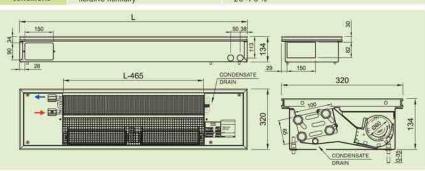

	SPEED			LENGTH [mm]		
	SPEED	1200	1600	2000	2400	2800
	1	<20	<20	<20	<20	<20
ACOUSTIC	2	20	22	25	25	25
PRESSURE L _{pAmox} [dB(A)]	3	30	32	34	35	36
	4	40	42	44	45	46
	5	48	49	51	52	53
	ï	47	66	100	114	147
AIR	2	89	123	179	195	266
VOLUME [m³/h]	3	134	191	266	336	394
	4	179	255	356	449	526
	5	212	302	422	532	624

Code example FCC4A-13240-NR217

Floor convector FCC4A-13, H=134 mm, W=320 mm, L=2400 mm, stainles steel trough, Al bronze frame, Al bronze cross roll-up grill, installed regulation, convector with fans 24V DC

Regulation is always a part of the convector, black covers of water and electricity. Ordering, see the page 44

SPECIFICATION

- Fully glazed rooms with big heat gains
- Flats, villas, residences, hotels
- High heat output
- Optimum after-cooling output
- · Convection with tangential fans
- Silent operation
- · Dry environment
- Safety voltage 24 V
- · Low consumption of electric energy
- Easy operation

HEATING OUTPUT

Q [W] 90/70/20°C

Speed level	Minimal	S	Standard level							
SPEED	1	2	3	4	5					
LENGTH [mm]		HEATIN	IG OUTPUT	Q,[W]						
1200	438	995	1621	1977	2141					
1600	657	1493	2431	2965	3211					
2000	876	1990	3242	3954	4281					
2400	1095	2488	4052	4942	5352					
2800	1314	2985	4862	5931	6422					

Qn [W] 75/65/20°C

Speed level	Minimal	S	Standard level							
SPEED	ï	2	3	4	5					
LENGTH [mm]		HEATIN	IG OUTPUT	[W],,O						
1200	364	827	1347	1643	1779					
1600	546	1241	2021	2465	2669					
2000	728	1654	2694	3286	3558					
2400	910	2068	3368	4108	4448					
2800	1092	2481	4041	4929	5337					

Q [W] 70/55/20°C

Speed level	Minimal	S	Standard level							
SPEED	1	2	3	4	5					
LENGTH [mm]		HEATIN	IG OUTPU	Q,[W]						
1200	309	701	1142	1393	1508					
1600	463	1052	1713	2090	2263					
2000	617	1402	2284	2786	3017					
2400	772	1753	2855	3483	3771					
2800	926	2104	3426	4179	4525					

Q [W] 55/45/20°C

Speed level	Minimal	S	Standard level						
SPEED	1	2	3	4	5				
LENGTH [mm]		HEATIN	IG OUTPU	[W],O					
1200	217	492	802	978	1059				
1600	325	739	1203	1467	1589				
2000	433	985	1604	1957	2119				
2400	542	1231	2005	2446	2648				
2800	650	1477	2406	2935	3178				

FCC4A-I3 24V CROSS-FLOW FAN CONVECTION



Q [W] 6/12 °C

Sp	eed le	vel	Min	imal			Standa	rd level			Maximal		
	SPEED		į	ı		2	:	3		4		5	
LENGTH	Trisci	r.v.[%]				COC	DUNG	DUTPUT	[W]				
[mm]	TI[°C]	TA [36]	Ok[W]	Qs[W]	Ok[W]	Qs[W]	Qk[W]	Q ₁ [W]	Ok[W]	Qs[W]	Qk[W]	Qs[W]	
	30	45	166	108	493	329	974	671	1087	781	1137	853	
1200	28	50	154	98	456	297	900	604	1005	701	1050	764	
1200	26	50	126	87	369	264	726	540	810	630	847	688	
	24	50	98	75	285	230	559	474	623	558	650	611	
	30	45	250	162	739	493	1461	1007	1630	1172	1706	1280	
1400	28	50	231	146	684	445	1350	906	1507	1051	1576	1145	
1600	26	50	189	130	554	397	1090	810	1216	945	1270	1032	
	24	50	148	113	427	346	838	711	934	836	975	916	
	30	45	333	216	986	657	1948	1343	2174	1562	2275	1706	
0000	28	50	308	195	912	593	1800	1207	2010	1402	2101	1527	
2000	26	50	253	174	739	529	1453	1080	1621	1260	1693	1376	
	24	50	197	151	570	461	1117	948	1245	1115	1301	1221	
	30	45	416	271	1232	821	2435	1679	2717	1953	2843	2133	
0.400	28	50	385	244	1140	741	2251	1509	2512	1752	2626	1909	
2400	26	50	316	217	924	661	1816	1350	2026	1576	2116	1720	
	24	50	246	189	712	576	1396	1185	1557	1394	1626	1527	
	30	45	499	325	1479	986	2921	2014	3261	2343	3412	2560	
0000	28	50	463	293	1368	890	2701	1811	3014	2103	3151	2291	
2800	26	50	379	261	1108	793	2179	1620	2431	1891	2540	2064	
	24	50	295	226	855	691	1676	1422	1868	1673	1951	1832	

Q [W] 12/16 °C

Sp	eed le	vel	Min	imal			Standa	rd level			Max	kimal
	SPEED		i	1	- 4	2	Ş	3	- 4	4		5
LENGTH	Tiled	Port				CO	DUNG (DUTPUT	[W]			
[mm]	Ti[°C]	7.y.[%]	Ok[W]	Qs[W]	Qk[W]	QqW]	Qk[W]	Q ₀ [W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	30	45	103	81	299	250	588	519	654	617	704	704
2000	28	50	90	71	262	218	513	451	571	536	599	597
1200	26	50	62	62	196	196	405	405	481	481	523	523
	24	50	53	53	163	163	337	337	399	399	431	431
	30	45	154	122	449	375	882	779	981	926	1056	1056
	28	50	135	106	394	327	770	676	856	804	899	896
1600	26	50	92	92	295	295	608	608	722	722	784	784
	24	50	80	80	245	245	505	505	599	599	647	647
	30	45	205	162	599	500	1176	1039	1308	1234	1408	1408
neteria.	28	50	180	141	525	436	1027	901	1142	1072	1199	1195
2000	26	50	123	123	393	393	811	811	962	962	1046	1046
	24	50	107	107	327	327	673	673	798	798	863	863
	30	45	256	203	749	625	1470	1298	1635	1543	1760	1760
	28	50	226	176	656	544	1284	1126	1427	1340	1498	1494
2400	26	50	154	154	491	491	1014	1014	1203	1203	1307	1307
	24	50	133	133	408	408	842	842	998	998	1078	1078
	30	45	308	244	898	750	1764	1558	1961	1851	2112	2112
0000	28	50	271	212	787	653	1540	1352	1712	1608	1798	1792
2800	26	50	185	185	589	589	1216	1216	1443	1443	1569	1569
	24	50	160	160	490	490	1010	1010	1197	1197	1294	1294

 $Qk\left[W\right]-total\ cooling\ output,\ Qs[W]-sensible\ cooling\ output\ RH[\%]-relative\ humidity$

CONDENSATE

If the cooling system is dimensioned so that condensate may occur (Qs<Qk), it is necessary to drain it from the convector. Condensate drips from lamellas of the exchanger to a drain chute, from which it flows out through a pipe on the convector right side. If condensate needs to be delivered to a collecting container or to a position above the convector, please use the condensate pump. Before use, check correct operation of the pump and its tightness by filling it with a small water amount through the exchanger. A float chamber must be cleaned from deposit dirt from time to time. Please follow instructions in the attached user manual.

Q [W] 8/14 °C

Sp	eed le	vel	Min	imal			Standa	rd level			Max	kimal
	SPEED		1	ı		2	;	3	- 4	4	: :	5
LENGTH	Tr I i cl	10/1				COC	DLING (OUTPUT	[W]			
[mm]	TI[C]	r.v,[%]	Qk[W]	Qs[W]	Qk[W]	Qs[W]	QK[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	30	45	140	96	411	294	807	602	897	707	937	778
7000	28	50	128	86	373	261	732	534	814	625	850	687
1200	26	50	98	75	284	227	555	469	617	554	645	611
	24	50	68	63	195	192	432	432	509	509	549	549
	30	45	210	144	617	440	1210	903	1346	1060	1406	1167
****	28	50	192	129	560	391	1099	801	1221	938	1276	1031
1600	26	50	148	112	426	341	832	704	926	831	967	916
	24	50	102	95	293	289	648	648	764	764	824	824
	30	45	280	192	822	587	1614	1204	1794	1413	1874	1555
	28	50	256	172	747	521	1465	1068	1628	1251	1701	1374
2000	26	50	197	149	568	455	1109	938	1234	1108	1289	1221
	24	50	136	126	391	385	864	864	1019	1019	1099	1099
	30	45	351	240	1028	734	2017	1504	2243	1767	2343	1944
0.400	28	50	320	215	933	651	1831	1335	2035	1564	2126	1718
2400	26	50	246	187	710	569	1387	1173	1543	1384	1612	1527
	24	50	170	158	489	481	1080	1080	1274	1274	1373	1373
	30	45	421	288	1234	881	2421	1805	2692	2120	2812	2333
	28	50	384	258	1120	782	2197	1602	2443	1876	2551	2061
2800	26	50	295	224	852	682	1664	1408	1851	1661	1934	1832
	24	50	204	189	586	577	1296	1296	1528	1528	1648	1648

Q [W] 16/18 °C

Sp	eed le	rel	Min	imal			Standa	rd level			Max	rimal
	SPEED		1	ı	- 3	2	;	3		1	0.5	5
LENGTH	T-11-01	r.v.[%]				COC	DUNG	DUTPUT	[W]			
[mm]	0.[35]	EA[-0]	Ok[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	30	45	67	67	211	211	442	442	529	529	583	583
1000	28	50	57	57	179	179	374	374	447	447	493	493
1200	26	50	48	48	148	148	307	307	367	367	402	402
	24	50	38	38	116	116	240	240	285	285	310	310
	30	45	101	101	316	316	663	663	794	794	875	875
1/00	28	50	86	86	268	268	561	561	671	671	739	739
1600	26	50	71	71	222	222	461	461	550	550	603	603
	24	50	57	57	174	174	359	359	427	427	464	464
	30	45	134	134	422	422	884	884	1059	1059	1167	1167
2000	28	50	115	115	358	358	748	748	894	894	985	985
2000	26	50	95	95	296	296	615	615	734	734	804	804
	24	50	75	75	231	231	479	479	570	570	619	619
	30	45	168	168	527	527	1104	1104	1323	1323	1458	1458
0.400	28	50	144	144	447	447	935	935	1118	1118	1232	1232
2400	26	50	119	119	369	369	768	768	917	917	1005	1005
	24	50	94	94	289	289	599	599	712	712	774	774
	30	45	202	202	633	633	1325	1325	1588	1588	1750	1750
0000	28	50	172	172	537	537	1122	1122	1342	1342	1478	1478
2800	26	50	143	143	443	443	922	922	1101	1101	1206	1206
	24	50	113	113	347	347	719	719	855	855	929	929

EXAMPLE OF CONNECTION OF A FLOOR CONVECTOR WITH A CONDENSATE PUMP



CONVECTORS FOR SWIMMING POOLS IZV DC



Floor convectors for wet conditions with axial fans achieve high thermal outputs. As advantage in hot summer days, they can be used also for cooling of window surfaces. The convectors are designed for heavy conditions – for pools, where they could be flooded with water for a short time period, for winter gardens etc. The convector is equipped with draining pipes on sides for water drainage. The trough is designed of special stainless steel DIN 1.4404, resistant to aggressive conditions (e.g. chlorine). They can be installed where is no high requirement for acoustic parameters. The convectors cannot be used at pools with salt water!

The convectors are equipped with a Cu-Cu wire exchanger, in which heating medium flows through. There are axial fans with air distributors positioned along the whole length before the exchanger. They assure regular coverage of the heat exchanger and as a consequence, optimum temperature distribution in the room.

- high capacity
- energy saving fans
- 12 V DC
- · 3-stage revolution control
- · wet conditions

TYPES DELIVERED WITH 12 V DC TECHNOLOGY:

FLB20-12 (270×125×800-4800 mm)

FANS 12 V DC

There are axial fans installed in convectors, with a design suitable for conditions with higher wetness and flooding with water. They work with direct voltage of 12 V DC.

TABLE OF FAN ELECTRIC POWER OF FLB (REGAULATOR RB25)

Maximum electric input power of 12V DC fans and a number of installed fans

The Control of the Co	Value (VIII)	8	00	12	000	16	00	20	00	24	00	28	300	32	00	36	00	40	000	44	00	48	300
TYPE	Voltage[V]*	W	pcs	W	pcs:	W	pcs:	W	pcs	W	pes	W	pcs	W	pcs	W	pcs	W	pes	W	pcs	W	pcs.
FLB20-12	12V DC	1,6	1	3,2	2	4,8	3	6,4	4	8	5	9,6	6	11,2	7	12,8	8	14,4	9	16	10	17,6	11

^{*} standardly, the input power is lower because of used regulator (operating voltage e.g. 8, 10,12 V DC)


RECOMMENDED STANDARD INSTALLING IN FLOOR

- · Convector installation with exchanger towards window
- · Ideal position 100-200 mm distance from window
- · Fan draws in the room air
- · The air is warmed up by flowing through exchanger
- · Hot air is mixed with cold air flowing off the window surface
- Air circulation: warms up the room air screens the window surface secondary demisters the window surface

100-200

CONVECTOR CONNECTION TO THE HEATING SYSTEM

Floor convector is fitted with openings for connection to the heating system. There are three connection possibilities, from the room, side or window wall.



FLB20-12



HEATING OUTPUT RECALCULATION FOR ANOTHER TEMPERATURE GRADIENT

Convector heating output reckoning follows by recalculation of the standardized output Qn $75/65/20~^\circ\text{C}$

$$Q = Qn * \Psi * \left(\frac{\Delta T}{50}\right)^m \text{ [W]; where } \Delta T = \left(\frac{T1 + T2}{2}\right) - Ti \text{ [°C]}$$

m=1,033 for FLB20-12

Qn	[W]	heating output for temperature gradient
		T1/T2/Ti = 75/65/20 °C
Ψ	[-]	mass rate of flow coefficient (for current flow rate $\psi=1$)
T1	[°C]	input water temperature
T2	[°C]	output water temperature
Ti	[°C]	temperature in the room
m	[-]	temperature exponent

QUICK CONVERSION TO TI=22 °C A TI=15 °C FOR ORIENTATION

- If you want to learn convector output for the room temperature of 22 °C or for a corridor temperature of 15°C
- multiply heating output of the chosen convector by the " \mathbf{k} " coefficient

for Ti=15°C, k=1.12 E.g.: Q [75/65/15°C] = 1.12 * Qn [75/65/20°C]

HEATING WATER FLOW RATE THROUGH EXCHANGER

M = 0.86Q/(T1-T2) [kg/h]

M	[kg/h]	mass rate of flow, heating water flowing through exchanger
Q	[W]	convector heating output
T1-T2	[°C]	difference between input and output temperature
0.86	[-]	invariable for recalculation of units

CONVECTOR DIMENSIONING BASED ON ACOUSTIC PARAMETERS

- Convector heating output must cover thermal loss in the room and observe the acoustic parameters
- · Permissible noisiness levels are determined by national legislation
- Different values of permissible noisiness levels are valid for residential houses, hospitals, offices, hotels etc.
- Heating output of convector with fan is designed for revolutions conforming with the lowest admissible acoustic pressure level in the room
- Tables of acoustic pressure L_{pAmax} [dB(A)] are in chapters relating to the single floor convector types
- Quoted measuring of acoustic parameters follows diagonally in the distance of 1m above and 1m in front of the convector
- The acoustic field may differ in dependence on:
 - convector placing in the room and its appropriate installation
 - the room space and segmentation (corners, partitions, ceiling)
 - furnishings as absorbing elements: tables, chairs, cupboards, wardrobes, carpets etc.
 - installation of more convectors in one room
 - sometimes, e.g. when convector is placed in a corner, the noisiness parameters may show values increased by 3dB(A)

EXCHANGER HYDRAULIC LOSSES

Tall Cartes 1	Length	Volume		M – mass rate of flow in piping (kg/h) / R – hydraulic loss in exchanger (kPa)											
TYPE	[mm]	m	M=20	40	60	80	100	120	150	200	250	300	350	400	450
	800	0,11	0,01	0,03	0,06	0,11	0,17	0,25	0,39	0,69	1,07	1,55	2,11	2,75	3,48
	0,21	0,01	0,03	0,08	0,14	0,21	0,30	0,48	0,85	1,32	1,91	2,59	3,39	4,29	
	1600	0,32	0,01	0,04	0,09	0,15	0,24	0,34	0,53	0,94	1,48	2,13	2,89	3,78	4,78
	2000	0,43	0,01	0,04	0,09	0,16	0,26	0,37	0,58	1,02	1,60	2,30	3,13	4,09	5,18
	2400	0,53	0,01	0,05	0,10	0,19	0,29	0,42	0,65	1,16	1,81	2,61	3,55	4,64	5,87
FLB20-12	2800	0,64	0,01	0,05	0,11	0,19	0,30	0,43	0,68	1,20	1,88	2,71	3,69	4,82	6,09
	3200	0,74	0,01	0,06	0,13	0,23	0,35	0,51	0,79	1,41	2,21	3,18	4,33	5,65	7,15
	3600	0,85	0,01	0,06	0,13	0,23	0,36	0,53	0,82	1,46	2,28	3,28	4,47	5,84	7,39
	4000	0,96	0,02	0,09	0,20	0,36	0,56	0,81	1,27	2,26	3,52	5,08	6,91	9,02	11,42
	4400	1,06	0,02	0,09	0,21	0,37	0,57	0,82	1,29	2,29	3,58	5,15	7,01	9,16	11,59
	4800	1,17	0,02	0,09	0,21	0,37	0,58	0,84	1,31	2,33	3,64	5,24	7,14	9,32	11,80

PARAMETERS OF LOCKSHIELD VALVES

T-turns	0,5	0,75	1	1,5	2	2,5	3	3,5	4	5	6	MAX
Kv (m³/h) - direct version	0,3	0,4	0,55	0,75	0,91	1,05	1,25	1,33	1,4	1,6	1,7	1,8
Kv (m³/h) – corner version	0,2	0,25	0,29	0,4	0,5	0,69	0,8	1	1,2	1,55	1,9	2,2

parameters of free packed in lockshield valves



REGULATION OF FLB 12V DC FLOOR CONVECTORS

Regulation of floor convectors for wet environment enables control of fan revolutions in three stages.

Control elements:


- Thermostat located in a room watches required temperature and switches fans according to the revolution switchk
- Revolution switch independently or in combination with the thermostat switches 3 revolution stages
- RB25 regulator transforms the network voltage to a safe voltage
 of 12 V (safety transformer). It is located outside the zone with wet
 conditions. RB25 supplies the thermostat and the voltage switch with
 12 V AC, fans in convectors with 12 V DC. The regulator is installed
 in a box built-in in a wall.

RB25 parameters:

- the regulator can control up to 25 fans (numbers see page 18)
- the regulator for convectors with axial fans three-stage regulation by means of a thermostat with a switch (e.g. Z-RT001+Z-RT002)
- dimensions 135×135×75 mm (box to be built-in in a wall outside the wet zone)
- a digital thermostat with a remote sensor can be used after consultation
- if a capacity of the regulator is used up, it is necessary to use an additional RB25 regulator

Remark: FLB regulation does not allow connection of a thermoelectric drive.

REGULATION: Z-RT001 THERMOSTAT, Z-RT002 SWITCH, RB25 REGULATOR

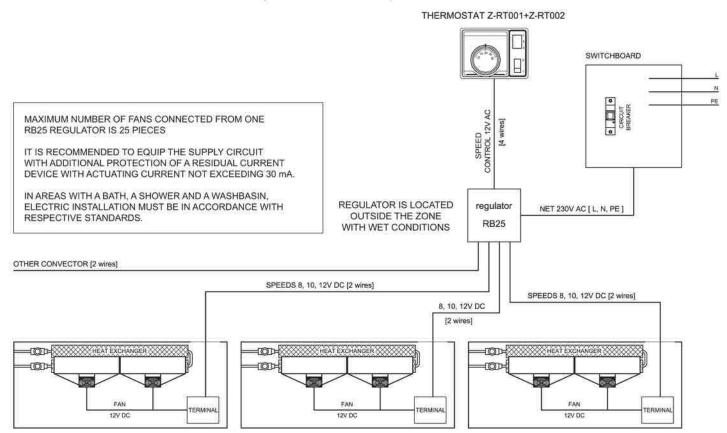

ACCESSORIES FOR IZV DC CONVECTORS



Z-DS002

Fan speed switch

Switch levels: 0, 1, 2, 3 230V / 50Hz Operating voltage: Max. rating: 6 (2.5) A Protection: **IP30** Colour: white 96×97×36 mm Dimension:



Z-RT001 + Z-RT002 - heating

manual room thermostat Z-RT001 placed at the sub-base Z-R002 with fan speed switch, heating. In this combination, it is possible to switch-off the fan and then thermostat control thermal actuator only (moderate heating).

Temperature range: 10-30 °C

Speed: 0, 1, 2, 3 Switch: 0/1 Switch levels:

Operating voltage: 230V / 50Hz 6 (2) A Max. rating: Protection: IP30 (thermostat) Colour: white

122×93×52 mm Dimension:



RB25 - regulator of revolutions for FLB convectors

three-stage regulator, switches over fans revolutions according to thermostat instructions. The regulator is in an installation box, which is built-in in a wall, outside the wet zone.

Operating voltage: Max. 230V / 50Hz Input: 230V / 50Hz

12V AC (thermostat, switcher) Output1:

Output2: 12V DC (fans)

Number of controlled fans: 25

135 x 135 x 75mm Dimension:



Z-RD002 direct, Z-RE002 corner

Lockshield valves

DN 15, NF norm Dimension: Connection thread:: M30×1,5 mm Max. working temperature: 120 °C Max. working overpressure: PN10

T- turns	0,25	0,5	1,0	1,5	2,0	3,0	4,0
k _v (m ³ /h)	0,13	0,22	0,43	0,65	0,85	1,25	1,7




FLB20-12 12V AXIAL FAN CONVECTION





PARAMETERS

	Width	270 mm
	Height	125 mm
	Length	800-4800 mm in step 400 mm
Convector	Height adjusting	adjusting leg
	Stainless trough width	250 mm
	Grill type	cross / linear
	Grill material	anodized aluminium, stainless steel
	Width	W. 196. 7 F. 196.
	Height	2 × Ø 65 mm
5.0	Finned length	L-440mm
xchanger	Heat medium connection	2 × G1/2" female thread
	Max. working temperature	110 °C
	Max. working overpressure	1 MPa
	Rotor diameter	Ø 90 mm
Fan	Operating voltage	Safe voltage 12V DC
ran	Ingress protection	IP55
	Regulation	by output voltage modification (regulator RB25,)
Operating	Ambient temperature	+2 to +40 °C
conditions	Relative humidity	20-70%

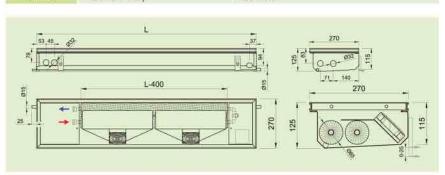

	COCCO		LENGHT [mm]									
	SPEED	800	1200	1600	2000	2400	2800	3200	3600	4000	4400	4800
ACOUSTIC PRESSURE LpAmox [dB(A)]	1	38	40	40	40	41	41	41	42	42	42	42
	2	41	43	44	45	46	46	46	46	46	46	46
	3	45	48	48	48	49	49	49	50	50	50	50
AIR VOLUME [m³/h]	1	28	63	93	126	154	190	224	254	293	307	335
	2	42	9.5	137	190	219	290	319	382	412	440	488
	3	62	138	200	274	341	413	499	550	658	691	753

Floor convector FLB20-12, H=125mm, W=270mm, L=2000mm, stainless steel trough, Al natur frame, Al natur cross roll-up grill, no regulation (not possible to place regulator inside the convector), convector 12V DC Code example FLB20-12200-NR110

Ordering, see the page 44

SPECIFICATIONS

- · full-area glassed rooms with high heat gains
- pools, wellness, winter gardens possibility to be flooded for a short time forced convection with axial fans

- heating and cooling low consumption of electric energy
- safe voltage of 12 V
- easy control
 Cu-Cu heat exchanger
- · easy cleaning hygiene
- · designed for wet conditions

HEATING OUTPUT Q [W] 75/65/20°C

SPEED		0		2	3
rpm		0			
LENGHT [mm]	- Th		HEATING (OUTPUT [W]	
	20	116	440	506	557
800	24	103	403	464	:511
	28	90	367	422	465
	20	231	879	1012	1114
1200	24	205	806	928	1022
	28	180	734	845	930
	20	347	1319	1518	1671
1600	24	308	1210	1392	1533
	28	270	1101	1267	1395
	20	463	1758	2024	2228
2000	24	410	1613	1857	204
	28	360	1468	1690	1861
	20	578	2198	2530	2785
2400	24	513	2016	2321	25.55
	28	450	1835	2112	2326
	20	694	2637	3035	3342
2800	24	615	2419	2785	3066
	28	540	2202	2535	2791
	20	810	3077	3541	3899
3200	24	718	2823	3249	3577
	28	630	2569	2957	3256
	20	925	3516	4047	4456
3600	24	820	3226	3713	4088
	28	720	2937	3380	3721
	20	1041	3956	4553	5013
4000	24	923	3629	4177	4599
	28	809	3304	3802	4186
	20	1157	4395	5059	5570
4400	24	1026	4032	4641	5110
	28	899	3671	4225	465
	20	1272	4835	5565	6126
4800	24	1128	4436	5106	562
	28	989	4038	4647	5116

O [W] 70/55/20°C

SPEED		0		2	3
трт		0			
LENGHT [mm]	TI.		HEATING (DUTPUT [W]	
	20	91	372	428	471
800	24	78	332	382	421
	28	66	296	340	375
	20	183	743	855	942
1200	24	156	664	765	842
	28	133	591	681	749
	20	274	1115	1283	1413
1600	24	235	997	1147	1260
	28	199	887	1021	1124
	20	366	1486	1711	1883
2000	24	313	1329	1530	1684
	28	266	1183	1361	1498
	20	457	1858	2138	2354
2400	24	391	1661	1912	2105
	28	332	1478	1701	1873
	20	549	2229	2566	2825
2800	24	469	1993	2294	2526
	28	399	1774	2042	2248
	20	540	2601	2994	3296
3200	24	548	2326	2677	2947
	28	465	2069	2382	2622
	20	732	2973	3422	3767
3600	24	626	2658	3059	3368
	28	532	2365	2722	2997
	20	823	3344	3849	4238
4000	24	704	2990	3442	3789
	28	598	2661	3062	3372
	20	915	3716	4277	4709
4400	24	782	3322	3824	4210
	28	665	2956	3403	3746
	20	1006	4087	4705	5179
4800	24	861	3654	4206	4631
	28	731	3252	3743	4121

FLB20-12 12V AXIAL FAN CONVECTION



Q [W] 6/12 °C, relative humidity 55 %

SPEED			I		2	2	3
rpm							
LENGTH [mm]	Ti [°C]		(COOLING	DUTPUT [V	4	
triscourt finni	0.15.04	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	24	256	160	274	174	299	194
1200	26	281	176	301	191	328	213
1200	28	305	191	327	207	356	232
	30	328	206	352	223	384	249
	24	384	241	412	261	449	292
7400	26	421	264	452	286	492	320
1600	28	457	287	490	311	535	347
	30	493	309	528	335	576	374
	24	512	321	549	348	598	389
2000	26	562	352	602	382	657	427
2000	28	610	382	654	414	713	463
	30	657	412	704	446	768	499
	24	640	401	686	435	748	486
0.400	26	702	440	753	477	821	533
2400	28	762	478	817	518	891	579
	30	821	514	880	558	960	624
	24	768	481	823	522	898	583
0000	26	843	528	903	572	985	640
2800	28	915	573	980	622	1 069	695
	30	985	617	1 056	669	1 151	748
	24	896	562	960	609	1 047	681
	26	983	616	1 054	668	1 149	747
3200	28	1 067	669	1 144	725	1 247	811
	30	1 150	720	1 232	781	1 343	873

Q [W] 10/15 $^{\circ}$ C, relative humidity 55 %

SPEED			T	2	2	3	3
rpm							
LENGTH [mm]	Ti [°C]			COOLING	DUTPUT [M	4	
trixotti fumi	11 (-)	Qk[W]	Q5[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	24	210	132	225	143	246	160
1200	26	237	148	254	161	277	180
1200	28	262	164	281	178	307	199
	30	287	180	308	195	335	218
	24	316	198	338	214	369	240
1600	26	355	223	381	241	415	270
1600	28	394	247	422	267	460	299
	30	430	270	461	292	503	327
	24	421	264	451	286	492	319
2000	26	474	297	508	322	554	360
2000	28	525	329	562	356	613	398
	30	574	360	615	390	671	436
	24	526	329	563	357	615	399
2400	26	592	371	634	402	692	450
2400	28	656	411	703	445	766	498
	30	717	450	769	487	838	545
	24	631	395	676	429	737	479
2800	26	711	445	761	483	830	540
2600	28	787	493	843	535	920	598
	30	861	539	923	585	1 006	654
	24	736	461	789	500	860	559
3200	26	829	519	888	563	969	629
3200	28	918	575	984	624	1 073	697
	30	1 004	629	1 076	682	1 174	763

Q [W] 14/18 °C, relative humidity 55 %

SPEED			i.		2	3	3					
rpm												
ENGTH [mm]	Ti [°C]	COOLING OUTPUT [W]										
EING) EI [mm]	m [se	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]					
	24	91	91	99	99	111	111					
1000	26	110	110	119	119	133	133					
1200	28	204	128	218	138	238	155					
	30	230	144	247	156	269	175					
	24	137	137	148	148	166	166					
1/00	26	165	165	179	179	200	200					
1600	28	305	191	327	207	357	232					
	30	345	216	370	235	404	262					
	24	183	183	198	198	221	221					
0000	26	220	220	238	238	266	266					
2000	28	407	255	436	277	476	309					
	30	461	289	494	313	538	350					

Ok [W] - total cooling output, Os[W] - sensible cooling output (air relative humidity 55 %)

Q [W] 8/14 °C, relative humidity 55 %

SPEED			I		2	3	3
rpm							
LENGTH [mm]	Ti [°C]	SEP CO.		COOLING	STREET, STREET	(drawanen-programs	Partie GW
CHOOCON CONTRACTOR		Ok[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	24	230	144	247	156	269	175
1200	26	256	160	274	174	299	194
1200	28	281	176	301	191	328	213
	30	305	191	327	207	356	232
	24	345	216	370	235	404	262
1400	26	384	241	412	261	449	292
1600	28	421	264	452	286	492	320
	30	457	287	490	311	535	347
2000	24	461	289	494	313	538	350
	26	512	321	549	348	598	389
2000	28	562	352	602	382	657	427
	30	610	382	654	414	713	463
	24	576	361	617	391	673	437
	26	640	401	686	435	748	486
2400	28	702	440	753	477	821	533
	30	762	478	817	518	891	579
	24	691	433	740	469	807	525
	26	768	481	823	522	898	583
2800	28	843	528	903	572	985	640
	30	915	573	980	622	1 069	695
	24	806	505	864	548	942	612
120/0707	26	896	562	960	609	1 047	681
3200	28	983	616	1 054	668	1 149	747
	30	1 067	669	1 144	725	1 247	811

Q [W] 12/16 $^{\circ}$ C, relative humidity 55 %

SPEED			I	1	2	3	3
rpm							
LENGTH [mm]	Ti [°C]		(COOLING	M TUPTUC	/]	
reactu [mm]	nt of	Qk[W]	Qs[W]	Qk[W]	Qs[W]	Qk[W]	Qs[W]
	24	190	119	203	129	222	144
1200	26	217	136	233	147	254	165
1200	28	243	152	261	165	284	185
	30	269	168	288	182	314	204
	24	285	178	305	193	332	216
7400	26	326	204	349	221	381	247
1600	28	365	229	391	248	426	277
	30	403	252	432	274	471	306
	24	379	238	407	258	443	288
0000	26	434	272	465	295	507	330
2000	28	487	305	521	331	569	370
	30	537	337	576	365	628	408
	24	474	297	508	322	554	360
0.400	26	543	340	582	369	634	412
2400	28	608	381	652	413	711	462
	30	671	421	719	456	785	510
	24	569	357	610	387	665	432
	26	651	408	698	442	761	495
2800	28	730	457	782	496	853	554
	30	806	505	863	547	942	612
	24	664	416	711	451	776	504
	26	760	476	814	516	888	577
3200	28	852	534	913	578	995	647
	30	940	589	1 007	639	1 098	714

Q [W] 14/18 °C, relative humidity 55 %

SPEED			1		2		3			
rpm										
LENGTH [mm]	Tr[°C]	COOLING OUTPUT [W]								
reiscorn fimm)	ut el	Qk[W]	Qs[W]	Ok[W]	Qs[W]	Qk[W]	Qs[W]			
	274	274	297	297	332	332	239			
2400	330	330	358	358	400	400	300			
2400	611	383	654	415	714	464	360			
	691	433	740	469	807	525	419			
	319	319	346	346	387	387	286			
2800	385	385	417	417	466	466	360			
2800	712	446	763	484	832	541	432			
	806	505	864	548	942	612	503			
	365	365	396	396	442	442	334			
2200	440	440	477	477	533	533	420			
3200	814	510	872	553	951	618	504			
	921	577	987	626	1 077	700	587			

CONVECTORS WITH NATURAL CONVECTION



Floor convectors with natural convection are especially suitable for installation to all-glass. The so installed convector creates a thermal curtain screening the cold air coming from the glass surface. A part of warm air streaming to the room heats up dwelling interiors. The floor convectors have been usually used as heating bodies supporting and supplementing the function of other heating systems. The floor convectors may also serve as the main heating bodies provided that the heating capacity thereof is sufficient. The floor convectors are also suitable for tempering of entrance halls, long corridors or industrial and commercial rooms.

The convectors are equipped with an Cu-Cu wire heat exchanger through which the heating medium is flowing. Cold air of the window and room absorbed by and heated up in exchanger spontaneously rises up to the window glass surface.


- Tempering of rooms
- Small water volume
- · Quick heating up
- · Broad assortment


TYPES:

FLK 10-09	(170×90×800-4800 mm)
FLK 10-11	(170×115×800-4800 mm)
FLK 10-14	(170×140×800-4800 mm)
FLK20-09	(320×90×800-4800 mm)
FLK20-11	(320×115×800-4800 mm)
FLK20-14	(320×140×800-4800 mm)
FLK30-09	(360×90×800-4800 mm)
FLK30-11	(360×115×800-4800 mm)
FLK30-14	(360×140×800-4800 mm)
FLK40-09	(420×90×800-4800 mm)
FLK40-11	(420×115×800-4800 mm)
FLK40-14	(420×140×800-4800 mm)
FLK20-18	(300×180×800-4800 mm)
FLK20-30	(300×300×800-4800 mm)
FLK30-18	(360×180×800-4800 mm)
FLK30-30	(360×300×800-4800 mm)

RECOMMENDED STANDARD INSTALLING IN FLOOR


- Ideal position 100-200 mm distance from window
- · The air is warmed up by flowing through exchanger
- · Hot air is mixed with cold air flowing off the window surface
- Air circulation: warms up the room air screens the window surface secondary demisters the window surface





CONVECTOR CONNECTION TO THE HEATING SYSTEM

Floor convector is fitted with openings for connection to the heating system. There are three connection possibilities, from the room, side or window wall.

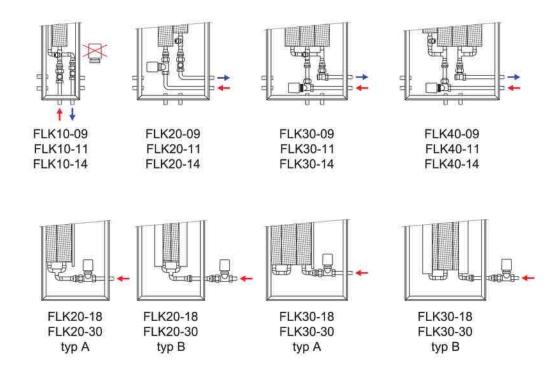



HEATING OUTPUT RECALCULATION FOR ANOTHER TEMPERATURE GRADIENT

Convector heating output reckoning follows by recalculation of the standardized output Qn 75/65/20 °C

$$Q = Qn * \Psi * \left(\frac{\Delta T}{50}\right)^m \text{ [W]; where } \Delta T = \left(\frac{T1 + T2}{2}\right) - Ti \text{ [°C]}$$

m= 1,45 for FLK 10-09 to FLK 40-14 m= 1,42 for FLK20-18 and FLK30-18 m= 1,49 for FLK20-30 and FLK30-30

[W] heating output for temperature gradient

T1/T2/Ti = 75/65/20 °C

[-] mass rate of flow coefficient (for current flow rate $\Psi=1$)

[°C] TI input water temperature

[°C] T2 output water temperature

[°C] temperature in the room [-]

temperature exponent

QUICK CONVERSION TO TI=22 °C A TI=15 °C FOR ORIENTATION

- If you want to learn convector output for the room temperature of 22 °C or for a corridor temperature of 15°C
- multiply heating output of the chosen convector by the "k" coefficient

For Ti=22°C, k=0.95

E.g.: Q [55/45/22 °C] = 0.95 * Q [55/45/20 °C]

for Ti=15°C, k=1.12

E.g.: Q [75/65/15 °C] = 1.12 * Qn [75/65/20 °C]

HEATING WATER FLOW RATE THROUGH EXCHANGER

M = 0.86Q/(T1-T2) [kg/h]

mass rate of flow, heating water flowing through [kg/h]

Q [W] convector heating output

T1-T2 [°C] difference between input and output temperature

0.86 [-] invariable for recalculation of units

EXCHANGER HYDRAULIC LOSSES

****	Length	Volume	M – mass rate of flow in piping (kg/h) / R – hydraulic loss in exchanger (kPa)												
TYPE	[mm]	m] [I]	M=20	40	60	80	100	120	150	200	250	300	350	400	450
	800	0,11	0,01	0,03	0,06	0,11	0,17	0,25	0,39	0,69	1,07	1,55	2,11	2,75	3,48
	1200	0,21	0,01	0,03	0,08	0,14	0,21	0,30	0,48	0,85	1,32	1,91	2,59	3,39	4,29
FLK 10-09	1600	0,32	0,01	0,04	0,09	0,15	0,24	0,34	0,53	0,94	1,48	2,13	2,89	3,78	4,78
FLK10-11	2000	0,43	0,01	0,04	0,09	0,16	0,26	0,37	0,58	1,02	1,60	2,30	3,13	4,09	5,18
FLK10-14	2400	0,53	0,01	0,05	0,10	0,19	0,29	0,42	0,65	1,16	1,81	2,61	3,55	4,64	5,87
FLK20-09 FLK20-11	2800	0,64	0,01	0,05	0,11	0,19	0,30	0,43	0,68	1,20	1,88	2,71	3,69	4,82	6,0
FLK20-14	3200	0,74	0,01	0,06	0,13	0,23	0,35	0,51	0,79	1,41	2,21	3,18	4,33	5,65	7,1
FLK20-18	3600	0,85	0,01	0,06	0,13	0,23	0,36	0,53	0,82	1,46	2,28	3,28	4,47	5,84	7,3
FLK20-30	4000	0,96	0,02	0,09	0,20	0,36	0,56	0,81	1,27	2,26	3,52	5,08	6,91	9,02	11,4
	4400	1,06	0,02	0,09	0,21	0,37	0,57	0,82	1,29	2,29	3,58	5,15	7,01	9,16	11,5
	4800	1,17	0,02	0,09	0,21	0,37	0,58	0,84	1,31	2,33	3,64	5,24	7,14	9,32	11,8
	800	0,17	0,01	0,04	0,09	0,16	0,25	0,36	0,56	1,00	1,55	2,24	3,05	3,98	5,0
	1200	0,32	0,01	0,04	0,10	0,18	0,27	0,39	0,62	1,10	1,71	2,47	3,36	4,39	5,5
FLK30-09	1600	0,48	0,01	0,05	0,12	0,22	0,34	0,49	0,76	1,36	2,12	3,05	4,15	5,43	6,8
	2000	0,65	0,02	0,07	0,16	0,28	0,44	0,63	0,98	1,74	2,72	3,92	5,33	6,96	8,8
FLK30-11	2400	0,80	0,02	0,09	0,21	0,37	0,58	0,83	1,30	2,32	3,62	5,21	7,09	9,26	11,7
FLK30-14	2800	0,96	0,03	0,10	0,23	0,40	0,63	0,91	1,42	2,52	3,93	5,67	7,71	10,07	12,7
FLK30-18 FLK30-30	3200	1,11	0,03	0,11	0,25	0,44	0,69	0,99	1,55	2,75	4,30	6,19	8,43	11,01	13,9
ILKSOOO	3600	1,28	0,03	0,13	0,28	0,50	0,78	1,13	1,76	3,13	4,89	7,05	9,59	12,53	15,8
	4000	1,44	0,04	0,16	0,36	0,63	0,99	1,43	2,23	3,97	6,20	8,93	12,15	15,87	20,0
	4400	1,59	0,05	0,18	0,41	0,74	1,15	1,66	2,59	4,60	7,20	10,36	14,10	18,42	23,3
	4800	1,76	0,05	0,21	0,47	0,83	1,30	1,88	2,93	5,21	8,15	11,73	15,97	20,86	26,4
	800	0,22	0,01	0,03	0,07	0,13	0,20	0,29	0,45	0,80	1,24	1,79	2,44	3,18	4,0
	1200	0,42	0,01	0,04	0,08	0,14	0,22	0,32	0,49	0,88	1,37	1,97	2,69	3,51	4,4
	1600	0,64	0,01	0,04	0,10	0,17	0,27	0,39	0,61	1,09	1,70	2,44	3,32	4,34	5,4
	2000	0,86	0,01	0,06	0,13	0,22	0,35	0,50	0,78	1,39	2,18	3,13	4,26	5,57	7,0
FLK40-09	2400	1,06	0,02	0,07	0,17	0,30	0,46	0,67	1,04	1,85	2,89	4,17	5,67	7,41	9,3
FLK40-11	2800	1,28	0,02	0,08	0,18	0,32	0,50	0,73	1,13	2,01	3,15	4,53	6,17	8,06	10,2
FLK40-14	3200	1,48	0,02	0,09	0,20	0,35	0,55	0,79	1,24	2,20	3,44	4,95	6,74	8,81	11,1
	3600	1,70	0,03	0,10	0,23	0,40	0,63	0,90	1,41	2,51	3,92	5,64	7,67	10,02	12,6
	4000	1,92	0,03	0,13	0,29	0,51	0,79	1,14	1,79	3,17	4,96	7,14	9,72	12,70	16,0
	4400	2,12	0,04	0,15	0,33	0,59	0,92	1,33	2,07	3,68	5,76	8,29	11,28	14,74	18,6
	4800	2,34	0,04	0,17	0,38	0,67	1,04	1,50	2,35	4,17	6,52	9,39	12,78	16,69	21,1

PARAMETERS OF LOCKSHIELD VALVES

T-turns	0,5	0,75	1	1,5	2	2,5	3	3,5	4	5	6	MAX
Kv (m³/h) - direct version	0,3	0,4	0,55	0,75	0,91	1,05	1,25	1,33	1,4	1,6	1,7	1,8
Kv (m³/h) - corner version	0,2	0,25	0,29	0,4	0,5	0,69	0,8	1	1,2	1,55	1,9	2,2

parameters of free packed in lockshield valves



For regulation of fanless floor convectors, a thermostatic valve is to be installed on the input tube of heat exchanger.

ROOM THERMOSTAT Z-RT001 AND THERMAL ACTUATOR Z-TS230


FLK convectors are regulated by means of thermo-drive opening or closing the heating medium circulation on the base of information by thermostat. The thermo-drive works in ON / OFF mode. Full circulation of heating medium follows within 3 minutes after the thermostat is activated.

Feeding voltage is 230V AC /50Hz. The thermo-drive hidden under the water connection is highly shielded with IP44 circuit breaker.

COMBINED USING OF CONVECTORS

In projects requiring combined installation of convectors fitted with 24V DC fans and convectors with natural convection, Z-TS24V thermo-drive controlled by convector fitted with regulator is used.

FLK - CABLING EXAMPLE FOR FLOOR CONVECTOR WITH Z-TS230

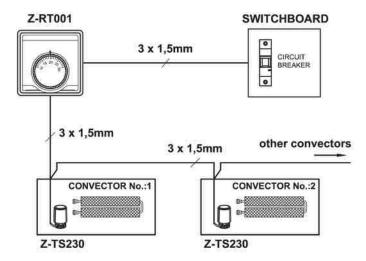


CAPILLARY THERMOSTAL Z-TF00

Thermostatic capillary head automatically controls keeping of the preset room temperature. The room temperature is regulated by user independently of any other power supply units. Keeping of the preset temperature is controlled by heat-sensitive element. Water volume in the heating body, necessary for keeping of the preset room temperature, is regulated by thermostatic valve.

The thermostatic capillary head has been installed on each convector.

FLK - CONNECTING WITH CAPILLARY THERMOSTAT Z-TF001

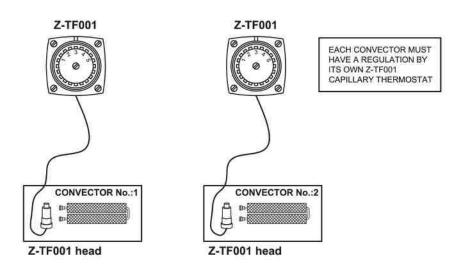

ACCESSORIEF FOR FLK CONVECTORS



Z-RT001

Room thermostat

Temperature range: 10 to 30 °C
Operating voltage: 230V/50Hz
Max, rating: 10 (3) A
Protection: IP30
Colour: white

Dimension: 83 × 83 × 40 mm



Z-TF001 (available for FLK only)

Capillary thermostat

Temperature range: 9 to 26°C, antifreeze temperature 9°C

Mode: proportional control

Operating temperature: without additional energy, liquid-filled sensing

capillara tube length: 5 m

Body-head connection: M30 × 1,5 mm


Dimension: 75×75 mm, sensor $\varnothing 50 \times 68$ mm



Z-TS230, Z-TS230-5m

230V / 50Hz Input voltage: Power input when switch on: 58VA Power input during operating: 2.5W Period of switching ON/OFF: 210 s Ingress protection: IP54 (housing) Connection thread: M30×1.5mm 3 meters Cable length: Z-TS230 Z-TS230-5m 5 meters

Max. height when opened: 74 mm



Z-TD001 / Z-TE001

Thermostatic valve direct/corner

DN15 version NF, M30 × 1,5 mm, PN10, 120°C

Valve adjusting	1	2	3	4	5	N
k (m ¹ /h)	0.1	0.2	0.31	0.45	0.69	0.89



Z-RD002 direct, Z-RE002 corner

Lockshield valves

Dimension: DN15, NF norm
Connection thread: M30×1,5 mm
Max. working temperature: 120 °C
Max. working overpressure: PN10

T - turns	0,25	0,5	1,0	1,5	2,0	3,0	4,0	
k, (m ³ /h)	0,13	0,22	0,43	0,65	0,85	1,25	1,7	



FLKIO-09 NATURAL CONVECTION



FLK20-09 NATURAL CONVECTION









SPECIFICATIONS

- Width 170 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience



SPECIFICATIONS

- Width 320 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience





FLK 40-09 NATURAL CONVECTION







SPECIFICATIONS

- Width 360 mm
- · Offices, corridors, halls, flats, winter garden
- High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience






SPECIFICATIONS

- Width 420 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience

FLK 10-09, FLK20-09, FLK30-09, FLK40-09 TECH-DATA



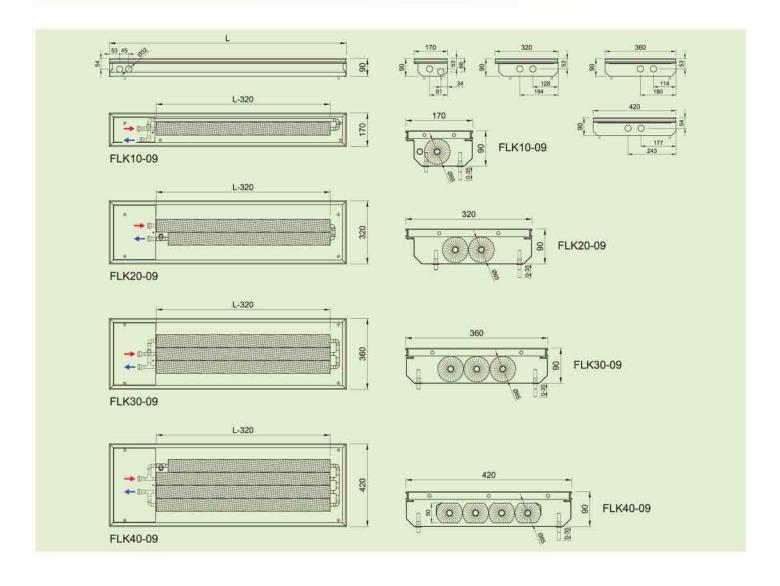

HEATING OUTPUT

Q [W] 90/70/20°C

TYPE	FLK10-09	FLK20-09	FLK30-09	FLK40-09
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	118	199	282	365
1200	214	366	511	656
1600	316	541	747	953
2000	419	721	986	1251
2400	523	902	1227	1552
2800	630	1088	1472	1856
3200	736	1276	1716	2156
3600	844	1466	1964	2462
4000	952	1657	2212	2767
4400	1063	1851	2462	3073
4800	1172	2046	2711	3376

Q [W] 70/55	/20°C
10000	III HOUSEVANDOSSI

TYPE	FLK10-09	FLK20-09	FLK30-09	FLK40-09
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	75	127	179	231
1200	137	234	326	419
1600	201	346	477	608
2000	267	461	630	799
2400	333	577	784	991
2800	401	695	940	1185
3200	469	815	1097	1378
3600	538	937	1255	1572
4000	607	1059	1413	1767
4400	677	1184	1573	1962
4800	747	1308	1733	2158

On [W] 75/65/20°C

TYPE	FLK10-09	FLK20-09	FLK30-09	FLK40-09
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	95	161	227	293
1200	173	296	413	530
1600	255	438	604	770
2000	338	583	797	1011
2400	422	730	992	1254
2800	508	880	1190	1500
3200	594	1032	1388	1744
3600	681	1186	1588	1990
4000	768	1341	1789	2237
4400	857	1498	1991	2484
4800	945	1655	2193	2731

Q [W] 55/45/20°C

TYPE	FLK10-09	FLK20-09	FLK30-09	FLK40-09
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	45	76	118	160
1200	81	140	211	282
1600	120	208	307	406
2000	159	277	406	535
2400	199	347	506	665
2800	240	419	606	793
3200	280	492	708	924
3600	321	565	808	1051
4000	363	639	911	1183
4400	405	714	1015	1316
4800	446	789	1118	1447

PARAMETERS

	Width	170, 320, 360, 420 mm			
	Height	90 mm			
à	Length	800-4800 mm in step 400 mm			
Convector	Height adjusting	0-35 mm			
3	Stainless trough width	150, 300, 360, 420 mm			
	Grill type	cross / linear			
	Grill material	anodized aluminium, wood, stainless steel			
	Width				
	Height	1×, 2×, 3×, 4× Ø 65 mm			
nger	Finned length	L-320 mm			
Exchanger	Heat medium connection	2 × G1/2* inner			
	Max. working temperature	110 °C			
	Max. working over- pressure	1 MPa			
ating ions	Ambient temperature	+2 to +40 °C			
Operating	Relative humidity	20-70 %			

FLKIO-II NATURAL CONVECTION



FLK 20-11 NATURAL CONVECTION









SPECIFICATIONS

- Width 170 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience



SPECIFICATIONS

- Width 320 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- Easy cleaning hygiene
- · Using in dry ambience





FLK 40-II NATURAL CONVECTION







SPECIFICATIONS

- Width 360 mm
- · Offices, corridors, halls, flats, winter garden
- High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience






SPECIFICATIONS

- Width 420 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience



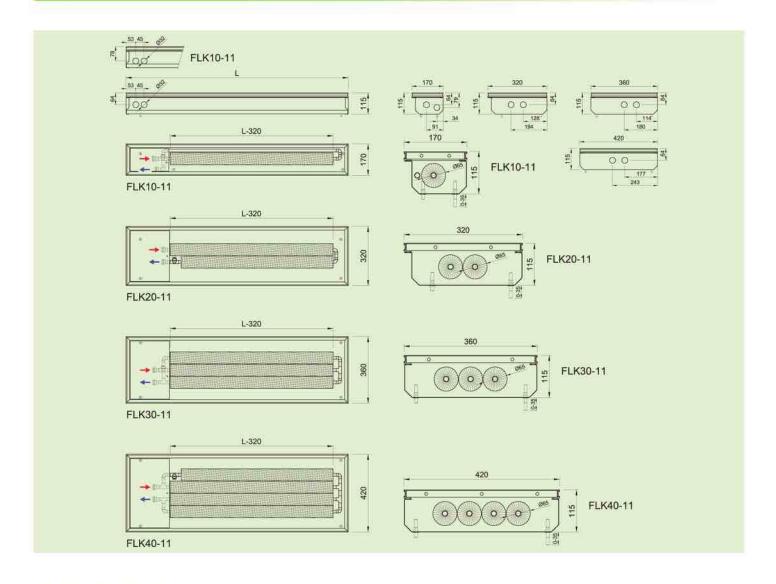

HEATING OUTPUT

Q [W] 90/70/20°C

TYPE	FLK10-11	FLK20-11	FLK30-11	FLK40-11
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	126	215	305	395
1200	230	398	546	694
1600	338	587	795	1003
2000	448	783	1052	1321
2400	560	980	1311	1642
2800	673	1182	1568	1954
3200	787	1386	1832	2278
3600	902	1592	2091	2590
4000	1019	1801	2358	2915
4400	1135	2011	2626	3241
4800	1253	2223	2895	3567

0	[///]	70	155	/20°	0
0		70	133	/20	•

TYPE	FLK10-11	FLK20-11	FLK30-11	FLK40-11
LENGTH [mm]		HEATING O	OUTPUT [W]	
800	81	137	194	251
1200	147	254	348	442
1600	216	375	507	639
2000	286	500	672	843
2400	357	627	837	1048
2800	429	755	1002	1248
3200	502	886	1170	1454
3600	575	1018	1336	1654
4000	649	1151	1507	1862
4400	724	1285	1678	2071
4800	799	1421	1850	2279

Qn [W] 75/65/20°C

TYPE	FLK10-11	FLK20-11	FLK30-11	FLK40-11
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	102	174	246	318
1200	186	322	441	560
1600	273	475	642	809
2000	362	633	850	1067
2400	452	793	1060	1327
2800	543	956	1268	1580
3200	635	1121	1481	1841
3600	728	1288	1691	2094
4000	822	1457	1907	2357
4400	916	1627	2124	2621
4800	1011	1798	2341	2884

Q [W] 55/45/20°C

TYPE	FLK10-11	FLK20-11	FLK30-11	FLK40-11
LENGTH [mm]		HEATING O	[W] TUPTUC	
800	48	84	118	152
1200	88	154	211	268
1600	129	227	307	387
2000	121	303	406	509
2400	213	379	506	633
2800	256	457	606	755
3200	300	536	708	880
3600	344	616	808	1000
4000	388	696	911	1126
4400	433	777	1015	1253
4800	478	859	1118	1377

PARAMETERS

	Width	170, 320, 360, 420 mm
	Height	11.5 mm
ħ	Length	800-4800 mm in step 400 mm
Convector	Height adjusting	0-35 mm
ŭ	Stainless trough width	150, 300, 360, 420 mm
	Grill type	cross / linear
	Grill material	anodized aluminium, wood, stainless steel
	Width	
	Height	1×, 2×, 3×, 4× Ø 65 mm
nger	Finned length	L-320 mm
Exchanger	Heat medium connection	2 × G1/2* inner
	Max. working temperature	110 °C
	Max. working over- pressure	1 MPa
perating	Ambient temperature	+2 to +40 °C
Open	Relative humidity	20-70 %

FLKIO-14 NATURAL CONVECTION



FLK20-14 NATURAL CONVECTION









SPECIFICATIONS

- Width 170 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience



SPECIFICATIONS

- Width 320 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- Easy cleaning hygiene
- · Using in dry ambience





FLK 40-14 NATURAL CONVECTION







SPECIFICATIONS

- Width 360 mm
- · Offices, corridors, halls, flats, winter garden
- High heating output of natural convection
- · Suitable for combining with other heating systems
- Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience






SPECIFICATIONS

- Width 420 mm
- · Offices, corridors, halls, flats, winter garden
- · High heating output of natural convection
- · Suitable for combining with other heating systems
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience



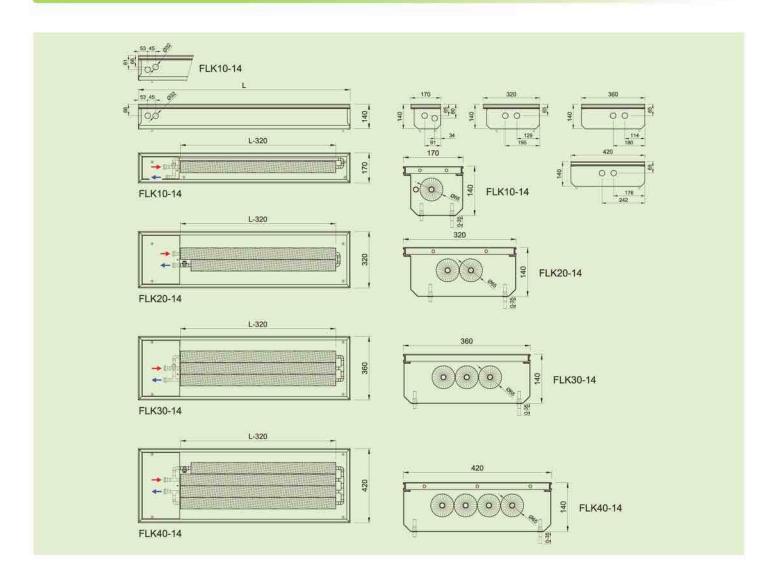

HEATING OUTPUT

Q [W] 90/70/20°C

TYPE	FLK10-14	FLK20-14	FLK30-14	FLK40-14
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	144	266	393	489
1200	264	493	704	860
1600	388	727	1025	1243
2000	515	970	1357	1638
2400	644	1215	1691	2036
2800	773	1465	2022	2422
3200	905	1718	2363	2824
3600	1037	1974	2697	3211
4000	1171	2233	3041	3614
4400	1305	2493	3387	4018
4800	1440	2756	3734	4423

Q [W] 70/55/20°C

TYPE	FLK10-14	FLK20-14	FLK30-14	FLK40-14
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	92	170	250	311
1200	168	315	449	548
1600	247	465	654	792
2000	329	619	866	1045
2400	410	777	1080	1300
2800	493	936	1292	1548
3200	577	1098	1509	1803
3600	661	1262	1723	2051
4000	747	1427	1944	2309
4400	832	1594	2164	2568
4800	918	1761	2385	2825

Qn [W] 75/65/20°C

TYPE	FLK10-14	FLK20-14	FLK30-14	FLK40-14
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	117	215	317	394
1200	213	399	568	694
1600	313	589	828	1003
2000	416	784	1096	1323
2400	519	983	1367	1645
2800	624	1185	1635	1959
3200	730	1390	1910	2282
3600	837	1597	2181	2596
4000	945	1806	2460	2922
4400	1053	2017	2739	3250
4800	1162	2229	3019	3576

Q [W] 55/45/20°C

TYPE	FLK10-14	FLK20-14	FLK30-14	FLK40-14
LENGTH [mm]		HEATING C	[W] TUPTUC	
800	55	104	152	188
1200	101	190	272	332
1600	148	281	396	479
2000	196	375	523	631
2400	244	469	652	784
2800	294	566	781	936
3200	345	664	913	1091
3600	395	763	1042	1240
4000	446	863	1175	1396
4400	497	963	1309	1553
4800	549	1065	1442	1707

PARAMETERS

	Width	170, 320, 360, 420 mm
	Height	140 mm
VL.	Length	800-4800 mm in step 400 mm
Convector	Height adjusting	0-35 mm
ď	Stainless trough width	150, 300, 360, 420 mm
	Grill type	cross / linear
	Grill material	anadized aluminium, wood, stainless steel
	Width	
	Height	1×, 2×, 3×, 4× Ø 65 mm
nger	Finned length	L-320 mm
Exchanger	Heat medium connection	2 × G1/2* inner
	Max. working temperature	110 °C
	Max. working over- pressure	1 MPa
erating	Ambient temperature	+2 to +40 °C
Operating	Relative humidity	20-70 %

FLK 20-18 NATURAL CONVECTION









SPECIFICATIONS

- Width 300 mm
- · Possibility of inner construction A or B
- · Installation to the double floor
- · Administrative buildings, offices
- · High heating output of natural convection
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience





SPECIFICATIONS

- Width 360 mm
- · Possibility of inner construction A or B
- · Installation to the double floor
- · Administrative buildings, offices
- · High heating output of natural convection
- · Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience











- Width 300 mm
- · Possibility of inner construction A or B
- · Installation to the double floor
- · Administrative buildings, offices
- · High heating output of natural convection
- Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience






- Width 360 mm
- · Possibility of inner construction A or B
- · Installation to the double floor
- · Administrative buildings, offices
- · High heating output of natural convection
- Cu-Cu wire heat exchanger
- · Mechanical resistance of the heat exchanger
- · Easy cleaning hygiene
- · Using in dry ambience

FLK 20-18, FLK30-18, FLK20-30, FLK30-30 TECH-DATA



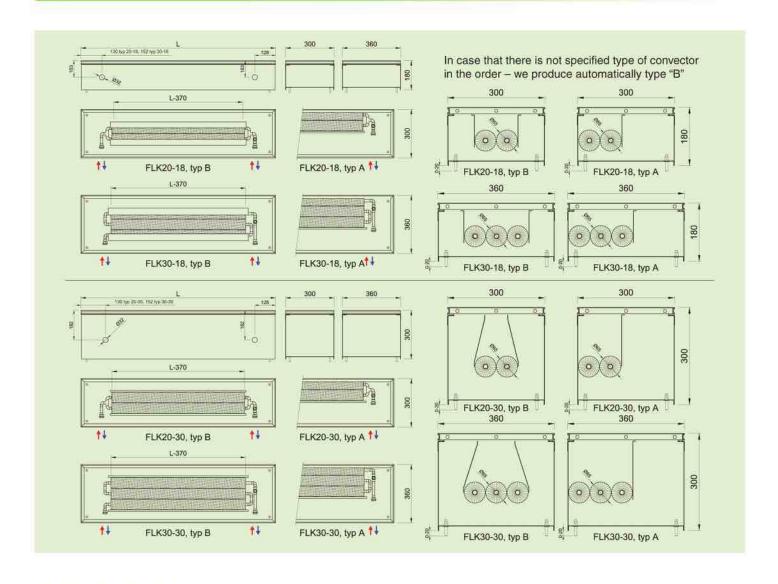

HEATING OUTPUT

Q [W] 90/70/20°C

TYPE	FLK20-18	FLK30-18	FLK20-30	FLK30-30
LENGTH [mm]		HEATING O	OUTPUT [W]	
800	333	381	379	550
1200	661	754	752	1090
1600	995	1135	1132	1641
2000	1309	1494	1489	2159
2400	1643	1875	1869	2710
2800	1970	2248	2241	3250
3200	2304	2629	2621	3801
3600	2618	2988	2978	4319
4000	2952	3369	3358	4870
4400	3286	3750	3738	5421
4800	3613	4123	4110	5961

	A		00	-	
On	[W]	75/	65	/20	10

TYPE	FLK20-18	FLK30-18	FLK20-30	FLK30-30
LENGTH [mm]		HEATING C	OUTPUT [W]	
800	257	293	289	419
1200	510	582	573	831
1600	767	875	862	1250
2000	1009	1152	1134	1645
2400	1267	1446	1423	2065
2800	1519	1734	1707	2476
3200	1777	2028	1996	2896
3600	2019	2304	2269	3290
4000	2277	2598	2558	3710
4400	2534	2892	2847	4130
4800	2787	3180	3131	4541

Q [W] 70/55/20°C

TYPE	FLK20-18	FLK30-18	FLK20-30	FLK30-30		
LENGTH [mm]	HEATING OUTPUT [W]					
800	204	233	227	329		
1200	405	462	450	652		
1600	609	695	677	981		
2000	801	915	890	1291		
2400	1006	1148	1117	1621		
2800	1206	1377	1340	1944		
3200	1411	1610	1567	2273		
3600	1603	1829	1781	2582		
4000	1808	2063	2008	2912		
4400	2012	2296	2235	3242		
4800	2213	2525	2458	3564		

Q [W] 55/45/20°C

TYPE	FLK20-18	FLK30-18	FLK20-30	FLK30-30		
LENGTH [mm]	HEATING OUTPUT [W]					
800	124	142	135	195		
1200	246	281	267	387		
1600	370	423	402	583		
2000	487	556	529	767		
2400	612	698	664	963		
2800	734	837	796	1155		
3200	858	979	931	1351		
3600	975	1113	1058	1535		
4000	1100	1255	1193	1731		
4400	1224	1397	1328	1926		
4800	1346	1536	1460	2118		

PARAMETERS

	Width	300, 360 mm
	Height	180, 300 mm
à	Length	800-4800 mm in step 400 mm
Convedor	Height adjusting	0-20 mm
ŭ	Stainless trough width	300, 360 mm
	Grill type	cross / linear
	Grill material	anodized aluminium, wood, stainless steel
	Width	
	Height	2×, 3× Ø 65 mm
nger	Finned length	L-370 mm
Exchange	Heat medium connection	2 × G1/2* inner
	Max, working temperature	110 °C
	Max. working over- pressure	1 MPa
ating	Ambient temperature	+2 to +40 °C
Opera	Relative humidity	20-70 %
Operating	O TORON TO A TOTAL CONTROL OF THE PARTY OF T	am ve a

ATYPICAL CONVECTORS



We deliver arched, broken-line and curved convectors to fit the architectural design of buildings and customer requirements. A large variety of shapes and arrangements of floor convectors can be delivered. It is important to specify in the customer order the dimensions and a detailed and accurate measurement of the actual shape.

The measurement of the convector, performed by the customer or by an IMAS Radiátory specialist, must be carried out on site on the actual structure (not based on the design). The level of completeness of the structure required for the measurement is as follows: final shape of the wall along which the convection heater is to be installed, windows mounted, access to the measuring area (scaffolding dismantled, etc.). The technical documentation developed for the convection heaters previously measured is discussed and approved by


the customer and technical details are agreed (water connection side, power connection). Following that, the manufacturing of the floor convector starts.



BROKEN-LINE SHAPE CONVECTORS

To allow for the design of the convector, the following measured values are necessary:

- lengths of the heater edges (window-side edges) and the angle formed by the edges (calculated using the length of the third leg of the triangle formed by the two edges), the angles α and β are used for verification only
- · width (type) of the convection heater
- · a sketch of the convection heater

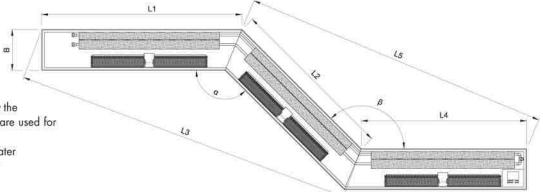

ARCHED CONVECTORS

To allow for the design of an arched convector, the following measured values are necessary:

- outer (inner) diameter of the arc and a total angle formed by the arc sector calculated using the distance of the end points and the diameter (for gentlecurved arcs) or the angle α (for arcs forming an angle larger than 120°)
- · width (type) of the convection heater
- · a sketch of the convection heater

or

- outer (inner) diameter of the arc and the perimeter length of the outer (inner) edge of the arc
- · width (type) of the convection heater
- · a sketch of the convection heater

Remember that regular shapes occur rarely in real structures.


Outer perimeter length Outer of a result of the second of

CURVED CONVECTORS

In case of more complicated shapes, it is necessary to use the reference points to determine the shape. It is recommenced that the measurements are per-

formed by IMAS Radiátory specialists. The convection heaters are delivered within individually agreed deadlines, usually in 15 to 20 working days.










PREVIEW OF THE ATYPICAL FLOOR CONVECTORS

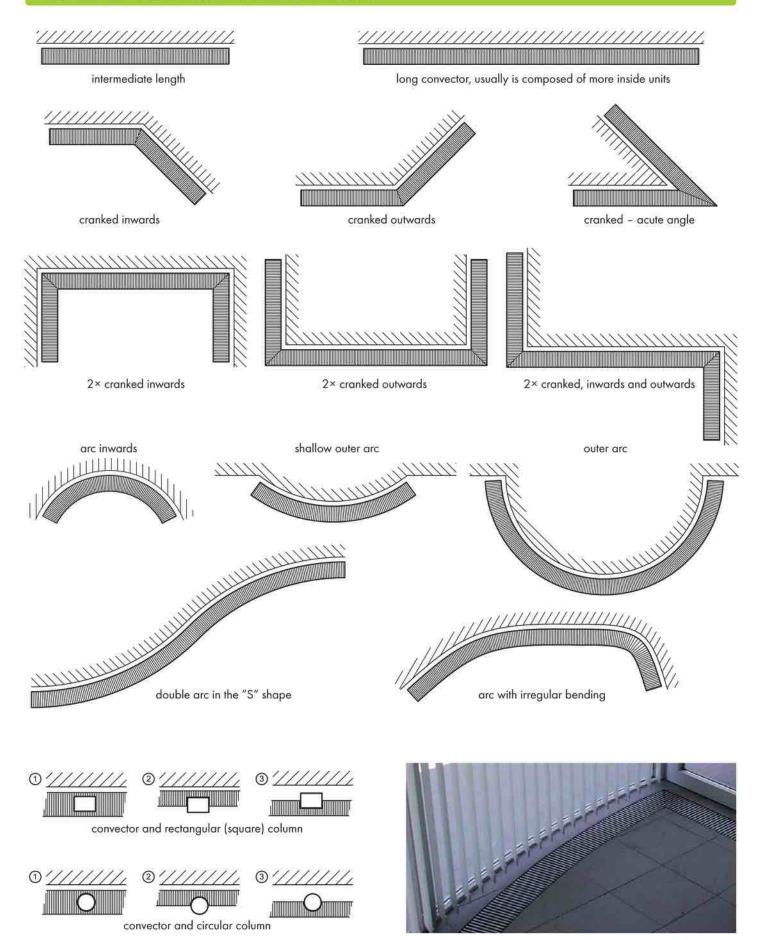

ORDERING FORM



1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18
F	L	T	2	0	*	ì	1	1	6	0	•	N	R	1	2	5	TE
	Model Activ		9	Convector type	Free position	Height	[cm]		Length [cm]		Atypical lengths	Surface finish of trough		Type and colour combination of the frame and grill		24V DC regulation or without regulation	Indication of the atypical design

LEGEND

Positions 1, 2, 3, 4, 5, 6, 7, 8	An overview of standard products – model, type, height
24V DC with fan	
FLT10	FLT10-09, FLT20-09
FLT20	FLT20-09, FLT20-11
FCC2A, FCC4A	FCC2A-13, FCC4A-13
12V DC with fan	
FLB	FLB20-12
with natural convection	
FLK10	FLK10.09, FLK10-11, FLK10-14
FLK20	FLK20-09, FLK20-11, FLK20-14, FLK20-18, FLK20-30
FLK30	FLK30-09, FLK30-11, FLK30-14, FLK30-18, FLK30-30
FLK40	FLK40-09, FLK40-11, FLK40-14

Positions 9, 10, 11, 12	
	convector length in centimeters, standards lengths are given in the power output tables for the individual types DYNAMIC - atypical length of convector is marked in mm including position 12
example:	
160	convector length 1600 mm, standard length
1400	convector length 1400 mm, atypical length
1675	convector length 1675 mm, atypical length

Position 13	Overview of available finishes of the convectors	
N	basic alternative, stainless steel convector without a surface finish (standard)	
В	spray painting of a tank and an exchanger to RAL 9005 matt	
1	colour RAL 7015 (dark grey, almost black) - matt	
2	colour RAL 9006 (aluminium colour) - matt	
3	colour RAL9005 black - matt	
.4	other colours (to be specified in the ordering form)	

the convector surface finishes B, 1, 2, 3, 4 are delivered for extra charge, the price is based on current quotation

Positions 14, 15, 16	Frame and grill specification (see pages 6, 7)
example:	
R 1 2	linear Al-grill, natural, Al-frame, natural
D11	Al-cross roll-up-grill natural, Al-frame natural, Al-finishing cover ledge, natural

grill and frame type must be specified in the order, R and D can't be changed after delivery



Position 17	Regulation of ACTIV convectors
24V DC with fan	
5	without regulator, convector with fans 24 V DC, control from th other convector or custom regulation
6	SR201, regulator for FLT10-09, FLT20-09, FLT10-11, FLT20-11, FLT21-12 (24V DC) placed in the convector
7	regulator 24V DC for FCC2A*, FCC4A*
12V DC with fan	
0	FLB are manufactured without regulation (not inside the convector), please order separately (regulator RB25)
With natural convection	
0	no regulator; the delivered convectors have no installed regulation
Position 18	Atypical floor convector
*	standard convector (position to be left free)
A	atypical convector, orders of atypical lengths, arched or other modified constructions (shape modification, additional holes, etc.).

Please enclose approved technical documentation or exact description and measurements of the required product, when ordering convectors of special lengths.

CODING OF GRILLS (see also page 6)

TRANSVERS ROLL-UP GRILL



WOODEN TRANSVERS ROLL-UP GRILL





R6-1 Grill: beech-natural roll, wood Frame: Al-natur, anodized



R6-2
Grill beech-stained roll, wood
Frame: Al-bronze, anodized



R6-3 Grill: oak-natural roll, wood Frame: Al-natur, anodized



Grill: aak-stained roll, wood Frame: Al-bronze, anodized

LINEAR GRILL

Lamellas are parallel to the length of the convector







R3-2 Grill: Al-black linear, coloured Frame: Al-black, coloured

STAINLESS STEEL GRILL

lamellas are placed perpendicularly to the length of the convector, grill is fixed, non-rolling.



R5-1 Grill: stainless steel, stainless steel Frame: Al-natur, anodized

^{*} FCC 24 V DC convectors have number 7 at position 17, the controller is always a part of the convector

ORDERING FORM





NUOVA IMAS Srl